



17th May, 2018
Ref. No. KW PCL/EMD/May/12

To,

Director (S)
Ministry of Environment Forest & Climate Change
Regional Office (WCZ)
Ground Floor, East Wing
New Secretariat Building, Civil Lines
Nagpur- 440001 (Maharashtra)

Sub.: Six Monthly Compliance Status of Environmental Clearance for 600 (1 x 600) MW Coal based Thermal Power Plant along with Environmental Monitoring reports.

Ref.: EC Letter No.: J-13012/57/2008-IA-II (T) dated 20th May, 2010 & Amendment dated 16th April, 2015.

Dear Sir,

With reference to above subject, please find enclosed herewith Six Monthly Environmental Clearance (EC) compliance status report along with environmental monitoring results like Ambient Air Quality, Water Quality, Noise level, Soil quality, Green belt development during the period of **October' 2017 to March' 2018**.

As you are kindly aware and we have informed vide our letter dated 12th June 2017, to CPCB New Delhi, Regional Office CPCB Bhopal, MS CEGB Raipur that our KW PCL Unit Generator is under major break down (Force Majeure) since 22nd May, 2017.

This is for your kind information & record please.

Thanking you with regards,

Your's faithfully
for Korba West Power Company Ltd.

(Gattu Rambhav)

Chief Operating Officer

Encl: As above

- cc: 1) **Member Secretary**, Central Pollution Control Board, PArivesh Bhavan, East Arjun Nagar, Kendriya Paryavaran Bhavan, New Delhi-110032.
2) **The Director**, Zonal Office, Central Pollution Control Board, 3rd Floor, Shahkar Bhavan, North TT Nagar, Bhopal- 462003
3) **Member Secretary**, CEGB, Paryawas Bhavan, North Block Sector-19, Naya Raipur, (C.G.)
4) **Regional Officer**, CEGB, TV Tower Road, Raigarh, (C.G.)

Korba West Power Company Limited

(CIN : U40102MP1995PLCC09177)

(A subsidiary of Avantha Power & Infrastructure Limited)

Village Chhole Bhandar, P.O. Bade Bhandar, Tehsil Pussore, District Raigarh - 496 100 Chhattisgarh, India

Registered Office: 301 'Rajnigandha', Green Garden Estate, City Center, Gwalior - 471 011, Madhya Pradesh, India

Corporate Office: 6th and 7th Floor, Vatika City Point, M.G. Road, Gurgaon - 122 002

Tel: +91-124-439000/01, Fax: +91-124-4376496, E-Mail: communications@avanthapower.com, www.avanthapower.com



AVANTHA
GROUP COMPANY

**SIX MONTHLY COMPLIANCE REPORT
OF ENVIRONMENTAL CLEARANCE**

**600 (1×600) MW THERMAL POWER
PLANT**

At

**BADE BHANDAR VILLAGE, PUSSORE TEHSIL
RAIGARH DISTRICT
CHHATTISGARH**

Submitted to:

**Ministry of Environment Forest, Climate Change
Regional Office (WCZ)
Ground Floor, East Wing
New Secretariat Building, Civil Lines
Nagpur – 440001 (Maharashtra)**

Submitted By:

**Environment Management Department
Korba West Power Company Limited
Bade & Chhote Bhandar Village, Pussore Tehsil
Raigarh District, Chhattisgarh**

PERIOD: October'2017– March'2018

CONTENTS

Sl. No.	Title	Annexures
1.	Introduction	
2.	Compliance status of Environment Clearance (EC)	
List of Annexures		
3.	<p>Environmental Monitoring Reports: For IIIrd Quarter Oct' 2017 to Dec' 2017 and IVth Quarter Jan'2018 to Mar'2018</p> <ul style="list-style-type: none">• Introduction• Project Profile• Scope of Study & Methodology• Sampling Location Map & Analysis Report• Conclusion	Annexure- I
4.	Green Belt/Plantation details	Annexure- II
5.	FlyAsh Utilization details	Annexure -III

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

COMPLIANCE STATUS ON ENVIRONMENTAL CLEARANCE

Vide Letter no.: F. No. J 13012/57/2008-IA.II (T), dated: 20th May 2010.
And amendment dated: 16th April 2015.

A. SPECIFIC CONDITIONS		
Sr. No.	CONDITIONS	COMPLIANCE STATUS
i	Detailed hydro-geological study shall be conducted and submitted within six months from an institute/organization of repute to assess impact of surface water regime. Specific mitigation measures shall be spelt out and action plan for implementation of the same shall be provided. It shall be ensured that the area drainage is not disturbed due to the proposed power plant.	Complied. Hydro-geological study has been done by reputed institute "National Institute of Hydrology, Roorkee" and report has already been submitted. The entire plant area is almost flat. There are no streams within the plant premises. Regular water quality monitoring being carried out by an agency accredited by MoEF.
ii	Hydro-geological study of the area shall be also reviewed annually and results submitted to the Ministry and concerned agency in the State Govt. In case adverse impact on ground water quantity and quality is observed at any stage, immediate mitigating steps to contain any adverse impact on ground water shall be undertaken.	Being Complied. The ground water quality and ground water level monitoring being carried out on regular basis monitoring report is enclosed as Annexure-I . Immediate necessary mitigating measures will be taken in case of any adverse condition is observed.
iii	Source of water for meeting the requirement during lean season shall be specified and submitted to the Regional Office of the Ministry within three months.	20 MCM Water allocations from Mahanadi River from Water Resources Dept. Govt. of Chhattisgarh. This quantity is adequate to meet the plant's requirement, including the lean season. Vide letter no. 1628/F4-66/31/S-2/OJPRE/07/ Raipur dated 20.03.2008.
iv	No ground water shall be extracted for use in operation of the power plant even in lean season.	Noted, Compliance assured.
v	No water bodies including natural drainage system in the area shall be disturbed due to activities associated with the setting up/operation of the power plant.	Noted There is no water body within the power plant premises.
vi	COC of 5.0 shall be adopted.	COC of 5.0 is being maintained.
vii	Local employable youth shall be trained in skills relevant to the project for eventual employment in the project itself. The action taken report and details thereof to this effect shall be submitted to the Regional Office of the Ministry and the State Govt. Dept. concerned from time to time.	Being Complied. Local employable youths were identified and were sent for ITI training in two batches of 43 and 15 in nos. respectively, training starting from Aug'11 for electrical and fitter trade for their employment in the company. 41 and 14 youths respectively from the first and second batch successfully completed

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

		<p>the training and 39 were given employment in the company.</p> <p>They were also given one month's extensive "Power Plant Familiarization training" from OMS TPRI, Bhubaneshwar.</p> <p>Also 20 youths were given construction skill training. Employment given to 5 youths who successfully completed the training.</p> <p>Employment camps in nearby villages have been organized by the company to identify potential candidates.</p> <p>Cooperative of local people has been formed wherein total 93 people were given employment as plantation/ greenbelt development activities etc.</p> <p>Besides above 58 number of local people given employment from nearby villages.</p>
viii	Additional soil for levelling of the proposed site shall be generated within the sites (to the extent possible) so that natural drainage system of the area is protected and improved.	The entire plant area is almost flat. There are no streams within the plant premises.
ix	Provision for installation of FGD shall be provided for future use.	Space for FGD is provided in plant layout.
x	A stack 275 m with flue gas velocity of 25 m/s shall be installed.	Complied. Flue Stack of 275 meter constructed. The designed flue gas velocity is more than 25 m/sec.
xi	High Efficiency Electrostatic Precipitators (ESPs) shall be installed to ensure that particulate emission does not exceed 50 mg/Nm ³ .	A High Efficiency Electrostatic Precipitators has been provided (ESP) to meet particulate emission less than 50 mg/Nm ³ .
xii	Adequate dust extraction system such as cyclones/ bag filters and water spray system in dusty areas such as in coal handling and ash handling points, transfer areas and other vulnerable dusty areas shall be provided.	Adequate dust suppression system like water sprinkling system, dust extraction system, dry fog dust suppression system has been installed throughout coal handling chain and bag filters in LHS, RHS bunkers and crusher house, The high concentrated slurry disposal system and closed transferring pipelines have installed for ash disposal in dyke.
xiii	Utilization of 100% Fly Ash generated shall be made from 4 th year of operation of the plant. Status of implementation shall be reported to the Regional Office of the Ministry from time to time.	Ash utilization plan/schedule has been incorporated in the EIA report. Implementation status of fly ash utilization is enclosed herewith. Please refer Annexure- III.
xiv	Fly ash shall be collected in dry form and storage facility (silos) shall be provided. Unutilized fly ash shall be disposed-off in the ash pond in the form of slurry form. Mercury and other heavy metals (As, Hg, Cr, Pb etc.) will be monitored in the bottom ash as also in the effluents emanating from the	Being Complied. We have established two nos. of silo (Intermediate and Main) with capacity of 1000 MT & 2500 MT respectively for utilization of dry fly ash. High concentration slurry disposal system is provided for disposal of unutilized ash in ash pond. Ash

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

	existing ash pond. No ash shall be disposed off in low lying area.	water circulation system is provided. Monitoring of Mercury and other heavy metals (As, Cr, Pb etc.) are being carried out regularly and reports are attached as Annexure- I.
xv	Ash pond shall be lined with HDP/LDP lining or any other suitable impermeable media such that no leachate takes place at any point of time. Adequate safety measures shall also be implemented to protect the ash dyke from getting breached.	Well-designed Ash pond with LDPE lining has been established as per guidelines of MoEF/CEA/CPCB. Safety measure such as bund with toe wall and lining of side slope done to prevent any leachate.
xvi	For disposal of Bottom Ash in abandoned mines (if proposed to be undertaken) it shall be ensured that the bottom and sides of the mined out areas are adequately lined with clay before Bottom Ash is filled up. The project proponent shall inform the State Pollution Control Board well in advance before undertaking the activity.	Compliance assured.
xvii	Green Belt consisting of 3 tiers of plantations of native species around plant and at least 100 m width shall be raised. Wherever 100 m width is not feasible a 50 m width shall be raised and adequate justification shall be submitted to the Ministry. Tree density shall not less than 2500 per ha with survival rate not less than 75 %.	Green belt / plantation are being developed. Approximate 1, 95,998 trees have been planted. Local plant species being preferred for the plantation as fast growing with thick canopy cover adequate height with longer duration of foliage, Perennial and evergreen along with fruit bearing plants in adequate have also been planted. Greenbelt development plan has been approved by DFO, which has already been submitted. Please refer Annexure- II
xviii	Two nearest village shall be adopted and basic amenities like development of roads, drinking water supply, primary health centre, primary school etc shall be developed in co-ordination with the district administration.	Being Complied Four project villages are adopted. Development of basic amenities such as construction of approach road, community hall, school room, safe drinking water facilities have been completed in all the adopted villages. Pond deepening work has been under taken in village Badebhandar and Sarwani. The CSR activities are ongoing.
xix	The project proponent shall also adequately contribute in the development of the neighbouring villages. Special package with implementation schedule for providing fluoride free potable drinking water supply in the nearby villages and schools shall be undertaken in a time bound manner.	CSR activities being carried out in consultation with district administration for the development of neighbouring villages. Also actively participating in GOI flagship program "Swachh Bharat Abhiyan" in coordination with district administration. Extended support for Mason and helper for construction of 141 individual household toilets in five nearby villages. Water analysis report attached is showing fluoride data in nearby ground water regime.

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

xx	A good action plan for R&R (if applicable) with package for the project affected persons be submitted and implemented as per prevalent R&R policy within three months from the date of issue of this letter.	The project is out of Abadi area. The R&R plan has already been prepared, implemented, under progress and submitted to MoEF & CECB, Raipur.
xxi	An amount of Rs 6.0 Crores shall be specially earmarked for development activities for tribals of the nearby villages as committed by the project proponent vide its letter dated 23.03.2010. Specific schemes for upliftment of tribal families mentioning sustainable livelihood schemes shall be submitted to the Ministry within three months with time bound implementation and in-built monitoring programme. The above amount shall be over and above the fund earmarked for CSR activities.	The requisite amount for tribal development has been spent and the expenditure report of 6.52 crore has been submitted. Specific livelihood schemes like poultry, mushroom production and vegetable cultivation is being carried out for upliftment of the tribal families. Tailoring training is also undergoing where interested tribal women is attending the training. Self-Help-Groups (SHGs) of women have been formed in the villages to take up various livelihood schemes. Two tribal cooperatives formed to take up various livelihood schemes. These are registered cooperative society. Besides above, infrastructure development activities like construction of CC road, community hall, sanskritik manch, drinking water facility etc. have been undertaken in the tribal villages for their upliftment.
xxii	Further an amount of Rs 15.0 Crores shall be earmarked as one time capital cost for CSR programme as committed by the project proponent vide its letter dated 23.03.2010. Subsequently a recurring expenditure of Rs 3.0 Crores per annum shall be earmarked as recurring expenditure for CSR activities. Details of the activities to be undertaken shall be submitted within one month along with road map for implementation.	Being complied The CSR activities are ongoing. The CSR activities undertaken for: 1. Infrastructure development in the villages, 2. Livelihood Enhancement and training, 3. Quality Education, 4. Community Health and 5. Promotion of Sports and Culture. Activities under Swachh Bharat Abhiyan also executed in neighbouring villages. Extended support for Mason and helper for construction of 141 individual household toilets in five nearby villages. Two community shed constructed in two villages.
xxiii	While identifying CSR programme the company shall conduct need based assessment for the nearby villages to study economic measures with action plan which can help in upliftment of poor section of society. Income generating projects consistent with the traditional skills of the people besides development of fodder farm, fruit bearing orchards, vocational training etc. can form a part of such programme. Company shall	Need Assessment Study conducted and submitted with previous compliance report The CSR activities are ongoing, CSR progress report is being submitted to Collector Raigarh & RO, CECB every month. Income generating activities consists of poultry farming, mushroom production, vegetable cultivation, dairy farming, cross breeding of non-descriptive cattle, grocery shops etc. 19th batch of 4-months tailoring

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

	provide separate budget for community development activities and income generating programmes. This will be in addition to vocational training for individuals imparted to take up self-employment and jobs.	training is running, by end of 18th batch total 472 women has been trained out of which 110 belongs to ST. Three cooperative societies formed for income generation named Surbhi Dugdh Utpadan Samiti, Gram Vikas Kamgar Samiti and Mahanadi Gramin Mahila Bahudesiye Sahkari Samiti. Executed MOA under PPP for up-gradation of ITI Saria, Raigarh district, constituted IMC.
xxiv	It shall be ensured that in-built monitoring mechanism for the schemes identified is in place and annual social audit shall be got done from the nearest government institute of repute in the region. The project proponent shall also submit the status of implementation of the scheme from time to time.	Social audit conducted and report submitted previously along with compliance report.
xxv	Harnessing solar power within the premises of the plant particularly at available roof tops shall be undertaken and status of implementation shall be submitted periodically to the Regional Office of the Ministry.	Noted, Compliance assured.
xxvi	A long term study on radio activity and heavy metals contents on coal to be used shall be carried out through a reputed institute. Thereafter mechanism for an in-built continuous monitoring for radio activity and heavy metals in coal and fly ash (including bottom ash) shall be put in place.	Compliance assured. The work for carrying out radioactive analysis is awarded to Board of Radiation and Isotope Technology, Department of Atomic Energy, Govt. of India. The results are awaited. We are using e-auction coal for operation of the unit, once the linkage coal will be supplied on full fledge the study and in-built continuous monitoring system will be carried. The heavy metal analysis in coal, fly ash and bottom ash is being carried on periodic basis. The results are enclosed as Annexure- I
xxvii	Mercury emissions shall also be monitored on periodic basis.	Being complied Mercury concentration in stack emissions and ambient air quality is being monitored on periodic basis by MoEF approved laboratory. The report is attached as Annexure- I . However the plant is under long breakdown since 22 nd May 2017, hence data of stack emission may not be generated and furnished.
xxviii	Fugitive emission shall be controlled to prevent impact on agricultural and non-agricultural land.	Compliance assured.
xxix	Fly ash shall not be used for agricultural purpose. No mine void filling will be undertaken as an option for ash utilization without adequate lining of mine with suitable	Noted, Compliance assured, if the activity is undertaken.

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

	media such that no leachate shall take place at any point of time. In case, the option of mine void filling is to be adopted, proper detailed study of soil characteristics of the mine area shall be undertaken from an institute of repute and adequate clay lining shall be ascertained by the State Pollution Control Board and implementation done in close co-ordination with the State Pollution Control Board.	
xxx	Green Belt shall also be developed around the ash pond over and above the Green Belt around the plant boundary.	Green belt / plantation are being developed. Approximate 1, 95,998 trees have been planted. Local plant species being preferred for the plantation / greenbelt development along the plant boundary as well as Ash Pond area.
xxxii	An Environmental Cell comprising of at least one expert in environmental science/ engineering, ecology, occupational health and social science, shall be created preferably at the project site itself and shall be headed by an officer of appropriate superiority and qualification. It shall be ensured that the Head of the Cell shall directly report to the Head of the Plant who would be accountable for implementation of environmental regulations and social impact improvement/ mitigation measures.	Noted, Complied
xxxiii	The project proponent shall formulate a well laid Corporate Environmental Policy and identify and designate responsible officers at all levels of its hierarchy for ensuring adherence to the policy and compliance with the conditions stipulated in this clearance letter and other applicable environmental laws and regulations.	Noted. Complied

B. GENERAL CONDITIONS

i	The treated effluents conforming to the prescribed standards only shall be re-circulated and reused within the plant. There shall be no discharge outside the plant boundary except during monsoon. Arrangements shall be made that effluents and storm water do not get mixed.	ETP has been established to treat effluents and treated water is being reuse within the premises. The concept of "Zero Discharge Condition" is implemented. Separate drainage network is established for storm water. Effluent water quality report is enclosed as Annexure - I.
ii	A sewage treatment plant shall be provided (as applicable) and the treated sewage shall be used for raising greenbelt/plantation.	Sewage Treatment Plants has been installed and the treated effluent is being used for plantation/greenbelt. Analysis report of STP is enclosed as Annexure- I.
iii	Rainwater harvesting should be adopted. Central Groundwater Authority/ Board shall be consulted for finalization of appropriate rainwater harvesting technology within a	A rain water harvesting & recharging system has already been constructed. 08 nos. of rain water harvesting ponds have been constructed within premises.

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

	period of three months from the date of clearance and details shall be furnished.	
iv	Adequate safety measures shall be provided in the plant area to check/minimize spontaneous fires in coal yard, especially during summer season. Copy of these measures with full details along with location plant layout shall be submitted to the Ministry as well as to the Regional Office of the Ministry.	Adequate safety team has been established in the plant site to take preventive control measures. Fire hydrant system provided for prevention of spontaneous fires in coal yard, especially during summer season.
v	Storage facilities for auxiliary liquid fuel such as LDO and/ HFO/LSHS shall be made in the plant area in consultation with Department of Explosives, Nagpur. Sulphur content in the liquid fuel will not exceed 0.5%. Disaster Management Plan shall be prepared to meet any eventuality in case of an accident taking place due to storage of oil.	The fuel such as LDO and HFO are properly stored in minimum risk area & in consultation with Department of Explosives, Nagpur after getting NOC for the same. Disaster management plan (DMP) has been prepared to handle the any eventuality in case of an accident taking place due to storage of oil.
vi	Regular monitoring of ground water level shall be carried out by establishing a network of existing wells and constructing new piezometers. Monitoring around the ash pond area shall be carried out particularly for heavy metals (Hg, Cr, As, Pb) and records maintained and submitted to the Regional Office of this Ministry. The data so obtained should be compared with the baseline data so as to ensure that the ground water quality is not adversely affected due to the project.	Piezometric wells installed and the monitoring result is enclosed as Annexure-I
vii	Monitoring surface water quantity and quality shall also be regularly conducted and records maintained. The monitored data shall be submitted to the Ministry regularly. Further, monitoring points shall be located between the plant and drainage in the direction of flow of ground water and records maintained. Monitoring for heavy metals in ground water shall be undertaken.	The surface water samples being collected and the analysis report is enclosed as Annexure- I.
viii	First Aid and sanitation arrangements shall be made for the drivers and other contract workers during construction phase.	First aid and sanitation for labours was provided during the construction.
ix	Noise levels emanating from turbines shall be so controlled such that the noise in the work zone shall be limited to 75 dBA. For people working in the high noise area, requisite personal protective equipment like earplugs/ear muffs etc. shall be provided. Workers engaged in noisy areas such as turbine area, air compressors etc shall be periodically examined to maintain audiometric record and	Necessary action has been taken to maintain noise levels in work zone area within 75 dB (A) from source during the plant operation. The personal protective equipment's (PPE) are provided to workers & employees working in noisy areas. Noise level monitoring is carried out regularly. Periodic audiometric check-up is being carried out.

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

	for treatment for any hearing loss including shifting to non-noisy/less noisy areas.	
x	Regular monitoring of ground level concentration of SO ₂ , NO _x , PM _{2.5} & PM ₁₀ and Hg shall be carried out in the impact zone and records maintained. If at any stage these levels are found to exceed the prescribed limits, necessary control measures shall be provided immediately. The location of the monitoring stations and frequency of monitoring shall be decided in consultation with SPCB. Periodic reports shall be submitted to the Regional Office of this Ministry. The data shall also be put on the website of the company.	Regular monitoring of SO ₂ , NO _x , PM _{2.5} & PM ₁₀ and Hg is being carried and records are being maintained during construction phase as well as operational phase. Environmental monitoring report is enclosed as Annexure- I . Three online Continuous Ambient Air Quality Monitoring Station (CAAQM) System and one mobile Van for Ambient Air Quality Monitoring have been establish within plant premise in consultation with Regional Office, Chhattisgarh Environment Conservation Board, Raigarh.
xi	Provision shall be made for the housing of construction labour (as applicable) within the site with all necessary infrastructure and facilities such as fuel for cooking, mobile toilets, mobile STP, safe drinking water, medical health care, crèche etc. The housing may be in the form of temporary structures to be removed after the completion of the project.	Complied. All necessary facilities were provided during construction for contractual labours.
xii	The project proponent shall advertise in at least two local newspapers widely circulated in the region around the project, one of which shall be in the vernacular language of the locality concerned within seven days from the date of this clearance letter, informing that the project has been accorded environmental clearance and copies of clearance letter are available with the State Pollution Control Board/Committee and may also be seen at Website of the Ministry of Environment and Forests at http://envfor.nic.in .	Complied. Advertised in three newspapers Hindustan Times, Dainik bhaskar & Nai Duniya on 28.02.2010
xiii	A copy of the clearance letter shall be sent by the proponent to concerned Panchayat, Zila Parisad / Municipal Corporation, urban local Body and the Local NGO, if any, from whom suggestions/ representations, if any, received while processing the proposal. The clearance letter shall also be put on the website of the Company by the proponent.	Complied. Copy of Environment Clearance has been provided to concerned authority. Compliance status updated in company website. http://www.avanthapower.com
xiv	A separate Environment Management Cell with qualified staff shall be set up for implementation of the stipulated environmental safeguards.	Being Complied. We have already established an Environment Management Cell with well qualified staff for implementation of the stipulated environmental safeguards.
xv	The proponent shall upload the status of compliance of the stipulated EC conditions, including results of monitored data on their website and shall update the same periodically.	Being Complied. Regular Environmental Monitoring report is being submitted to Regional office, MoEF, CPCB and CECB, Chhattisgarh. The

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

	It shall simultaneously be sent to the Regional Office of MOEF, the respective Zonal Office of CPCB and the SPCB. The criteria pollutant levels namely; SPM, RSPM (PM _{2.5} & PM ₁₀), SO ₂ , NO _x (ambient levels as well as stack emissions) shall be displayed at a convenient location near the main gate of the company in the public domain.	environmental parameters display board provided at main gate of the plant. Compliance status updated in company website. http://www.avanthapower.com
xvi	The environment statement for each financial year ending 31 st March in Form-V as is mandated to be submitted by the project proponent to the concerned State Pollution Control Board as prescribed under the Environment (Protection) Rules, 1986, as amended subsequently, shall also be put on the website of the company along with the status of compliance of environmental clearance conditions and shall also be sent to the respective Regional Offices of the Ministry by e-mail.	The environment Statement for the year 2016-17 has been submitted to Chhattisgarh Environment Conservation Board (CECB) vide letter no. KWPC/EMD/Sept./15, dated-25/09/2017.
xvii	The project proponent shall submit six monthly reports on the status of the implementation of the stipulated environmental safeguards to the Ministry of Environment and Forests, its Regional Office, Central Pollution Control Board and State Pollution Control Board. The project proponent shall upload the status of compliance of the environment of the environmental clearance conditions on their website and update the same periodically and simultaneously send the same by e-mail to the Regional Office, Ministry of Environment and Forests.	Being Complied. Six monthly Environmental Clearance compliance status report is regularly submitted to MoEF, CPCB and SPCB. The same is sent by email also. Last compliance report for the period of Apr'17 - Sept'17 had been submitted to your good office via our letter no. KWPC/EMD/November/10 dated 27 th November 2017. Compliance status being updated on company website. http://www.avanthapower.com
xviii	Regional Office of the Ministry of Environment & Forests will monitor the implementation of the stipulated conditions. A complete set of documents including Environmental Impact Assessment Report and Environment Management Plan along with the additional information submitted from time to time shall be forwarded to the Regional Office for their use during monitoring. Project proponent will up-load the compliance status in their website and up-date the same from time to time at least six monthly basis. Criteria pollutants levels including NO _x (from stack & ambient air) shall be displayed at the main gate of the power plant.	Noted, Being complied
xix	Separate funds shall be allocated for implementation of environmental protection measures along with item-wise break-up. These cost shall be included as part of the project	Being Complied

KORBA WEST POWER COMPANY LTD.
(1x600 MW Coal Based Thermal Power Plant)

	cost. The funds earmarked for the environment protection measures shall not be diverted for other purposes and year-wise expenditure should be reported to the Ministry.	A separate fund has already been allocated for implementation of environmental protection.
xx	The project authorities shall inform the Regional Office as well as the Ministry regarding the date of financial closure and final approval of the project by the concerned authorities and the dates of start of land development work and commissioning of plant.	Complied.
xxi	Full cooperation shall be extended to the Scientists/Officers from the Ministry / Regional Office of the Ministry at Bangalore / CPCB/ SPCB who would be monitoring the compliance of environmental status.	Noted, Full co-operation shall be extended to all concerned authorities.
C. Conditions of EC Amendment Letter		
i	The coal shall be transported on road through mechanically covered trucks.	Noted. The vehicles are engaged for coal transporting are mechanically covered and periodic refresher training is also being imparted on traffic for safety and environment rules.
ii	Avenue plantation of 2/3 rows all along the road for transportation of coal shall be carried out by the project proponent at its own expenses in consultation with the State Government Authorities.	Plantation / greenbelt activities is being planned in consultation with state forest department on both sides of road. However, the proposed coal transportation road is under widening and construction by NHAI.
iii	Periodic maintenance of the roads used for transportation of coal shall be carried out by the project proponent at its own expenses and shall also facilitate the traffic control on the roads in consultation with State Government Authorities.	Noted, Being followed. However, the proposed coal transportation road is under widening and construction by NHAI.

ANNEXURE-I

3rd & 4th Quarterly Environmental Monitoring Report



Submitted To:

**M/s Korba West Power Company Limited
Village Chhote Bhandar, Post office Bade Bhandar,
Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)**

Conducted by:

**M/s Vardan EnviroLab
Village- Samaspur, Opposite Amity School, Sector-51,
Gurgaon (Haryana)**

(Recognized by MoEF & CC, NABL Government of India)

PREFACE

The growing concern for environmental protection and the passing of various environmental legislations have increased the responsibilities of Ministry of Environment, Forests & Climate Change, Pollution Control boards in many folds. Besides enforcing the various environmental legislations MoEF&CC, CPCB & SPCB strive to propagate the necessity awareness regarding the various legal provisions and environmental protection measures in the country.

Electric Power scenario has occupied a significant place in the development program of the country. Development and environment can neither be separated nor ignored. In fact, they are complimentary to each other. These issues have become a concern of the community, particularly the environment impact due to industries in the developing countries.

However, the prerequisite for sustainable development is judicious planning of environmental status, likely impacts of the approach adopted on the environment including inhabitants of the locality, availability of the eco-friendly technology, emerging waste disposal and waste utilization processes, techniques of land reclamation for the restoration of aesthetic beauty and soon.

Korba West Power Company Limited (KWPCCL), Village Chote Bhandar, Post Office Bade Bhandar, Raigarh-496100, India, has engaged M/S Vardan EnviroLab, Gurgaon, (HR) to provide Environmental Services in respect of ambient air quality monitoring, stack emission, noise level monitoring & Sampling and Analysis of ground water quality, surface water quality, treated effluent sewage, effluent water from ETP, and soil for KWPCCL, Raigarg district of Chhattisgharh, as per guidelines of MoEF&CC and CPCB Gazette notification.

M/S Vardan EnviroLab, Gurgaon, (HR) has deployed entirely its own personnel, facilities and expertise for doing this service. Sampling / Monitoring Stations were identified by the Environmental Officer of KWPCCL. The samples were analyzed partly at site and partly at our MoEF Recognized laboratory situated at Gurgaon (HR).

This report presents the data generated for 3rd quarter (21st December 2017 to 22nd December 2017) and 4th quarter (26th February 2018 to 28th February 2018) which includes sampling locations, Methodology, testing procedure and compilation for the Environmental parameters i.e. Air, Water & Noise with a view to evaluate the impact due to the thermal power plant activities.

During the course of our operations for the above task, the staff and management of KWPCCL were extremely co-operative. We are grateful to them for their invaluable support and assistance rendered to us during the course of the sampling and monitoring.

Date : 24-13-2018



INDEX

Sr.No.	Contents	Page No.
1.0	Introduction	3
2.0	Project Profile	4
2.1	Topography and Drainage	4
2.2	Location	4
2.3	Climate	4
2.4	Communication	4
2.5	Location Map	5
3.0	Scope of Study and Methodology	6
3.1	Scope of Study	6
3.2	Methodology	6
3.2.1	Air Environment	6
3.2.2	Water Environment	6
3.2.3	Noise Environment	7
3.2.4	Soil	7
4.0	Sampling Location Map and Analysis Reports	8
4.1	Ambient Air Quality Monitoring	8 to 19
4.2	Noise Level Monitoring	20 to 37
4.3	Ground water Quality Analysis	38 to 59
4.4	Surface water Quality Analysis	60 to 79
4.5	Soil Quality Analysis	80-91
4.6	Effluent Sample Analysis	92-97
4.7	Drinking water Analysis	98-103
4.8	Ground water level Monitoring	104-107
5.0	Conclusion	108
5.1	Air Environment	108
5.2	Water Environment	108
5.3	Noise Environment	108

Chapter - 1.0

INTRODUCTION

Korba West Power Company Limited (KWPC), a subsidiary of Avantha Power & Infrastructure Limited, is a power generation company based at Raigarh in the State of Chattisgarh, KWPC has recently commissioned its Thermal Power Plant first 600MW Unit at Village Chote Bhandar, Post Office Bade Bhandar, Raigarh- 496100, India. The second unit of 600MW is under implementation. KWPC is also committed towards the environment and the community it operates in. It has successfully implemented several community welfare schemes in the field of livelihood, infrastructure, community health and education which has so far benefited over 60,000 people from close to 75 villages.



Figure No.1. Korba West Power Company Limited (KWPC)

Chapter - 2.0

PROJECT PROFILE

2.1 Topography & Drainage

Topography of this area is generally undulating. The area is drained by Mand River approximately 3 km. away from plant in North direction and Mahanadi River approximately 5 km. away from plant in South direction.

2.2 Location

Plant is bounded by Northern Latitudes of 21° 44' 00" to 21° 44' 42" and Eastern Longitude of 83° 16' 30" to 83° 17' 18". This area falls in the survey of India toposheet no. 64 O/1, 64 O/2, 64 O/5 and 64 O/6. The location of the mine area is shown in Fig. No. 2

2.3 Climate

The climate of the area is Sub-tropical type. It is in the zone of humid tropic climate where temperature and humidity of air are very high. The temperature varies from the minimum - maximum temperature range between 29.5°C - 49 °C in summer, and 8°C - 25 °C in winter. The humidity varies from 35% to 82%. The annual average rainfall in the area is about 1300 mm.

2.4 Communication

The nearest railway station is Kirodimal, which is at a distance of ~23 Km towards North direction. The area is well connected with N.H. No. 216. Nearest Airport is Raipur ~250 km in SW direction. Nearest village is Bade Bhandar ~ 1 km. in North direction and nearest town is Raigarh ~21 km. in North-East direction.

2.5 Location Map

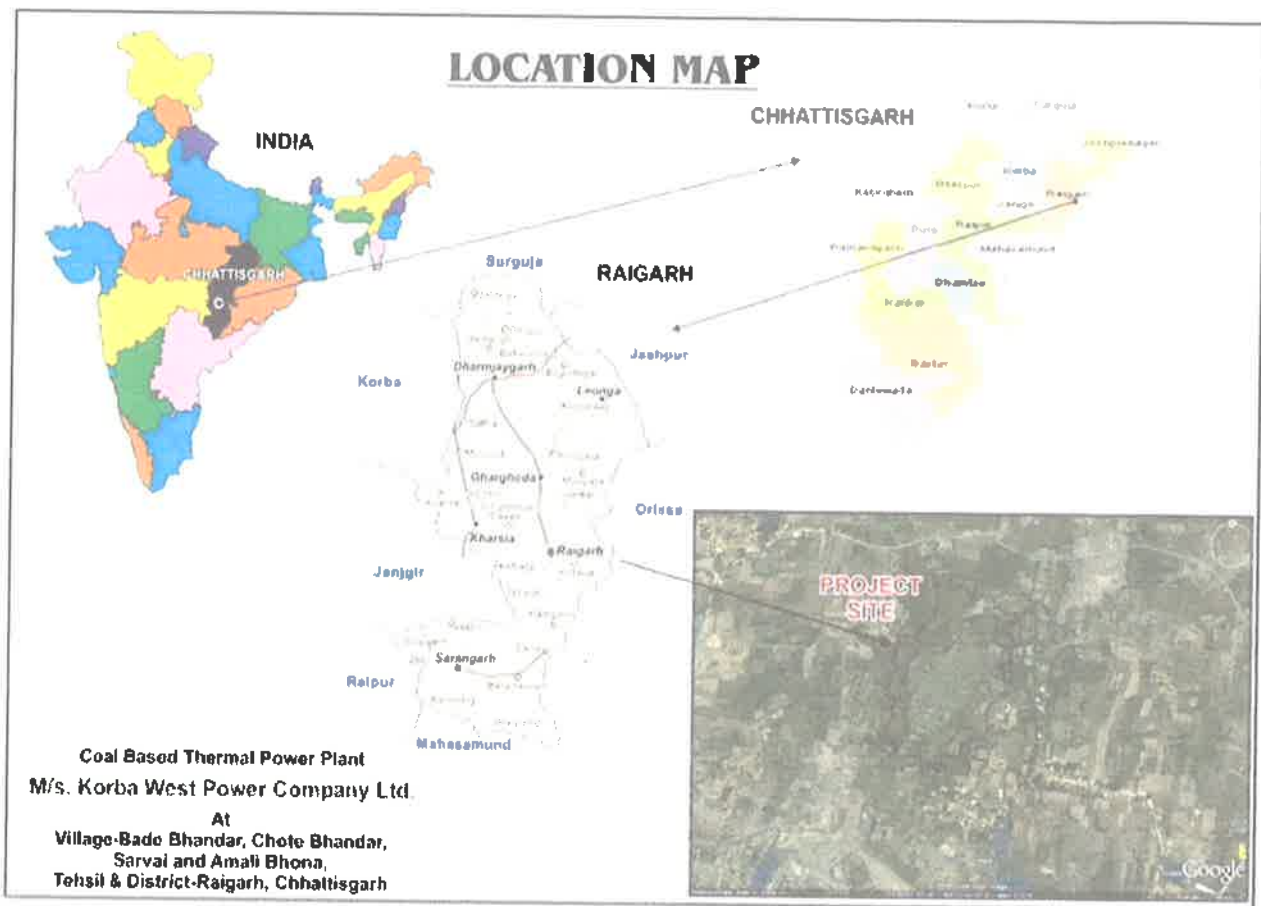


Figure No.2. Location Map

Chapter – 3.0

SCOPE OF STUDY AND METHODOLOGY

3.1 Scope of Study

The scope of study includes Environmental Services in respect of ambient air quality monitoring, noise level monitoring & Sampling and Analysis of Drinking water, Ground water quality and surface water quality, treated effluent sewage, effluent water from ETP, soil and Ground water level monitoring.

3.2 Methodology

As mentioned in the scope of work covering the various Environmental components monitoring and sampling and its analysis was carried out on the basis of guidelines of Ministry of Environment Forest & Climate Control of Government of India & Chattisgarh State Pollution Control Board. Sampling procedure method reference and Analysis procedure method reference are mentioned in monitoring reports.

3.2.1 Ambient Air Quality Monitoring

Third and Fourth Quarter Environmental Monitoring Reports of ambient air quality has been carried out at various sources of air pollution surrounding and in the Plant. The prime objective of the ambient air quality monitoring is to assess the existing air quality of the area.

The ambient air quality monitoring was carried out for 24 hours at each station. At all stations SO₂, NO₂, PM₁₀, PM_{2.5}, CO and Mercury were monitored. All the samples collected were analyzed for quantitative analysis of various pollutants.

The ambient air quality sampling locations were identified by the Environmental Officer of KWPCCL.

3.2.2 Water Environment

Third and Fourth Quarter Environmental Monitoring Reports of ground water samples, surface water samples were collected from selected locations in two liter sterilized plastic cans. These samples were analyzed as per IS 10500:2012. The domestic effluent and Industrial effluent samples were collected and analyzed for parameters: pH, Total suspended solids, Biochemical Oxygen Demand, Chemical Oxygen Demand and Oil & Grease.

3.2.3 Noise Environment

Third and Fourth Quarter Environmental Monitoring Reports of Sound level meter was used to know the sound levels generated due to plant activities at different locations. The measurements were taken for Equivalent sound level over a time period for day and night which is expressed in dB(A).

3.2.4 Soil

Third and Fourth Quarter Environmental Monitoring Reports of Soil samples were collected from selected locations. These samples were analyzed for Physico-Chemical parameters including heavy metals.

Chapter - 4.0

SAMPLING LOCATION MAP AND ANALYSIS REPORTS Third Quarter Environmental Monitoring

4.1 Ambient Air Quality Monitoring

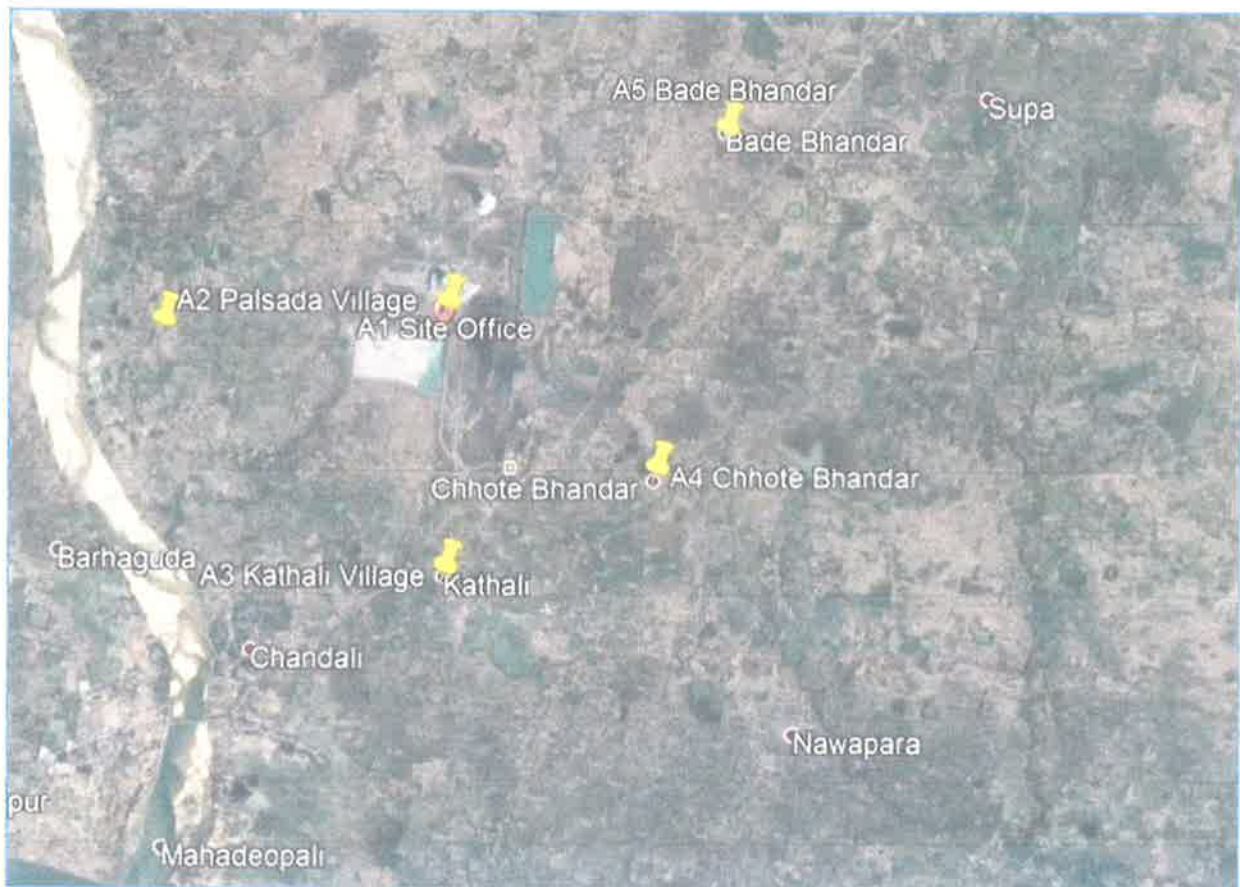


Figure No.3. Plan Showing Ambient Air Quality Location Map

Location Code: -	A1- Site Office
	A2- Palsada Village
	A3- Kathali Village
	A4- Chote Bhandar Village
	A5- Bade Bhandar Village



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/01 **Report No.:** VEL/A/1712/001
Name & Address of the Party: M/s Korba West Power Company **Format No.:** 5.10 F-01
 Limited Village Chhote Bhandar, Post **Party Reference No.:** NIL
 office Bade Bhandar, Tehsil Pussore, **Reporting Date:** 28/12/2017
 Dist.-Raigarh -496100 (Chhattisgarh)
Receipt Date: 25/12/2017 **Period of Analysis:** 25/12/2017-27/12/2017

Sample Description: AMBIENT AIR QUALITY MONITORING

General Information:-

Client Representative : Mr. Amit Soni
Sample collected by : Vardan Enviro Lab Representative
Sampling Location : Site Office
Instrument Used : RDS & FPS sampler with all Accessories
Instrument Code : VEL/RDS/06 & VEL/FPS/06
Instrument Calibration Status : Calibrated
Meteorological condition during monitoring : Clear Sky
Date of Monitoring : 21/12/2017 to 22/12/2017
Time of Monitoring : 24 hours
Ambient Temperature (°C) : Min. 12.3 Max. 27.7
Surrounding Activity : Human and Vehicular activities
Scope of Monitoring : Regulatory Requirement
Control measure if Any : ---
Sampling & Analysis Protocol : IS-5182
Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	*SOP No. VEL/SOP/01, Section No. SP 63	42.4	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	80.1	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	23.1	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	13.6	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.87	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS – National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.
 # SOP- Laboratory Standard Operating Procedure.

(Signature)
 (Tested By)

(Signature)
 (Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced, wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/02 **Report No.:** VEL/A/1712/002
Name & Address of the Party: M/s Korba West Power Company **Format No.:** 5.10 F-01
 Limited Village Chhote Bhandar, Post **Party Reference No.:** NIL
 office Bade Bhandar, Tehsil Pussore, **Reporting Date:** 28/12/2017
 Dist.-Raigarh -496100 (Chhattisgarh) **Period of Analysis:** 25/12/2017-27/12/2017
Receipt Date: 25/12/2017

Sample Description: AMBIENT AIR QUALITY MONITORING

General Information:-

Client Representative : Mr. Amit Soni
Sample collected by : Vardan Enviro Lab Representative
Sampling Location : Village Palsada
Instrument Used : RDS & FPS sampler with all Accessories
Instrument Code : VEL/RDS/07 & VEL/FPS/07
Instrument Calibration Status : Calibrated
Meteorological condition during monitoring : Clear Sky
Date of Monitoring : 21/12/2017 to 22/12/2017
Time of Monitoring : 24 hours
Ambient Temperature (°C) : Min. 12.1 Max. 27.4
Surrounding Activity : Human and Vehicular activities
Scope of Monitoring : Regulatory Requirement
Control measure if Any : ---
Sampling & Analysis Protocol : IS-5182
Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	#SOP No. VEL/SOP/01, Section No. SP 63	43.8	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	77.1	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	22.8	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	9.1	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.75	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS – National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.

SOP- Laboratory Standard Operating Procedure.

Shishir
(Tested By)

Muniba
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced, wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/03 **Report No.:** VEL/A/1712/003
Name & Address of the Party: M/s Korba West Power Company **Format No.:** 5.10 F-01
 Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh) **Party Reference No.:** NIL
Receipt Date: 25/12/2017 **Reporting Date:** 28/12/2017
Period of Analysis: 25/12/2017-27/12/2017

Sample Description: AMBIENT AIR QUALITY MONITORING

General Information:-

Client Representative : Mr. Amit Soni
Sample collected by : Vardan Enviro Lab Representative
Sampling Location : Village Kathli
Instrument Used : RDS & FPS sampler with all Accessories
Instrument Code : VEL/RDS/08 & VEL/FPS/08
Instrument Calibration Status : Calibrated
Meteorological condition during monitoring : Clear Sky
Date of Monitoring : 21/12/2017 to 22/12/2017
Time of Monitoring : 24 hours
Ambient Temperature (°C) : Min. 12.8 Max. 27.0
Surrounding Activity : Human and Vehicular activities
Scope of Monitoring : Regulatory Requirement
Control measure if Any : ---
Sampling & Analysis Protocol : IS-5182
Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	#SOP No. VEL/SOP/01, Section No. SP 63	44.6	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	76.5	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	27.8	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	8.5	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.78	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS - National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.

SOP- Laboratory Standard Operating Procedure.

(Signature)
(Tested By)

(Signature)
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Page 1 of 1



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/04 **Report No.:** VEL/A/1712/004
Name & Address of the Party: M/s Korba West Power Company **Format No.:** 5.10 F-01
 Limited Village Chhote Bhandar, Post **Party Reference No.:** NIL
 office Bade Bhandar, Tehsil Pussore, **Reporting Date:** 28/12/2017
 Dist.-Raigarh -496100 (Chhattisgarh) **Period of Analysis:** 25/12/2017-27/12/2017
Receipt Date: 25/12/2017

Sample Description: AMBIENT AIR QUALITY MONITORING


General Information:-

Client Representative : Mr. Amit Soni
Sample collected by : Vardan Enviro Lab Representative
Sampling Location : Village Chhote Bhandar
Instrument Used : RDS & FPS sampler with all Accessories
Instrument Code : VEL/RDS/09 & VEL/FPS/09
Instrument Calibration Status : Calibrated
Meteorological condition during monitoring : Clear Sky
Date of Monitoring : 21/12/2017 to 22/12/2017
Time of Monitoring : 24 hours
Ambient Temperature (°C) : Min. 12.9 Max. 27.4
Surrounding Activity : Human and Vehicular activities
Scope of Monitoring : Regulatory Requirement
Control measure if Any : ---
Sampling & Analysis Protocol : IS-5182
Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	#SOP No. VEL/SOP/01, Section No. SP 63	43.5	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	83.4	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	24.7	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	11.2	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.89	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS - National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.

SOP- Laboratory Standard Operating Procedure.


 (Tested By)


 (Checked By)



Page 1 of 1

NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/05 **Report No.:** VEL/A/1712/005
Name & Address of the Party: M/s Korba West Power Company **Format No.:** 5.10 F-01
 Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, **Party Reference No.:** NIL
 Dist.-Raigarh -496100 (Chhattisgarh) **Reporting Date:** 28/12/2017
Receipt Date: 25/12/2017 **Period of Analysis:** 25/12/2017-27/12/2017

Sample Description: AMBIENT AIR QUALITY MONITORING

General Information:-

Client Representative : Mr. Amit Soni
Sample collected by : Vardan Enviro Lab Representative
Sampling Location : Village Bade Bhandar
Instrument Used : RDS & FPS sampler with all Accessories
Instrument Code : VEL/RDS/10 & VEL/FPS/10
Instrument Calibration Status : Calibrated
Meteorological condition during monitoring : Clear Sky
Date of Monitoring : 21/12/2017 to 22/12/2017
Time of Monitoring : 24 hours
Ambient Temperature (°C) : Min. 12.0 Max. 27.8
Surrounding Activity : Human and Vehicular activities
Scope of Monitoring : Regulatory Requirement
Control measure if Any : ---
Sampling & Analysis Protocol : IS-5182
Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	#SOP No. VEL/SOP/01, Section No. SP 63	47.4	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	83.8	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	28.7	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	9.4	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.80	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS – National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.

SOP- Laboratory Standard Operating Procedure.


 (Tested By)


 (Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Fourth Quarter Environmental Monitoring

4.1 Ambient Air Quality Monitoring

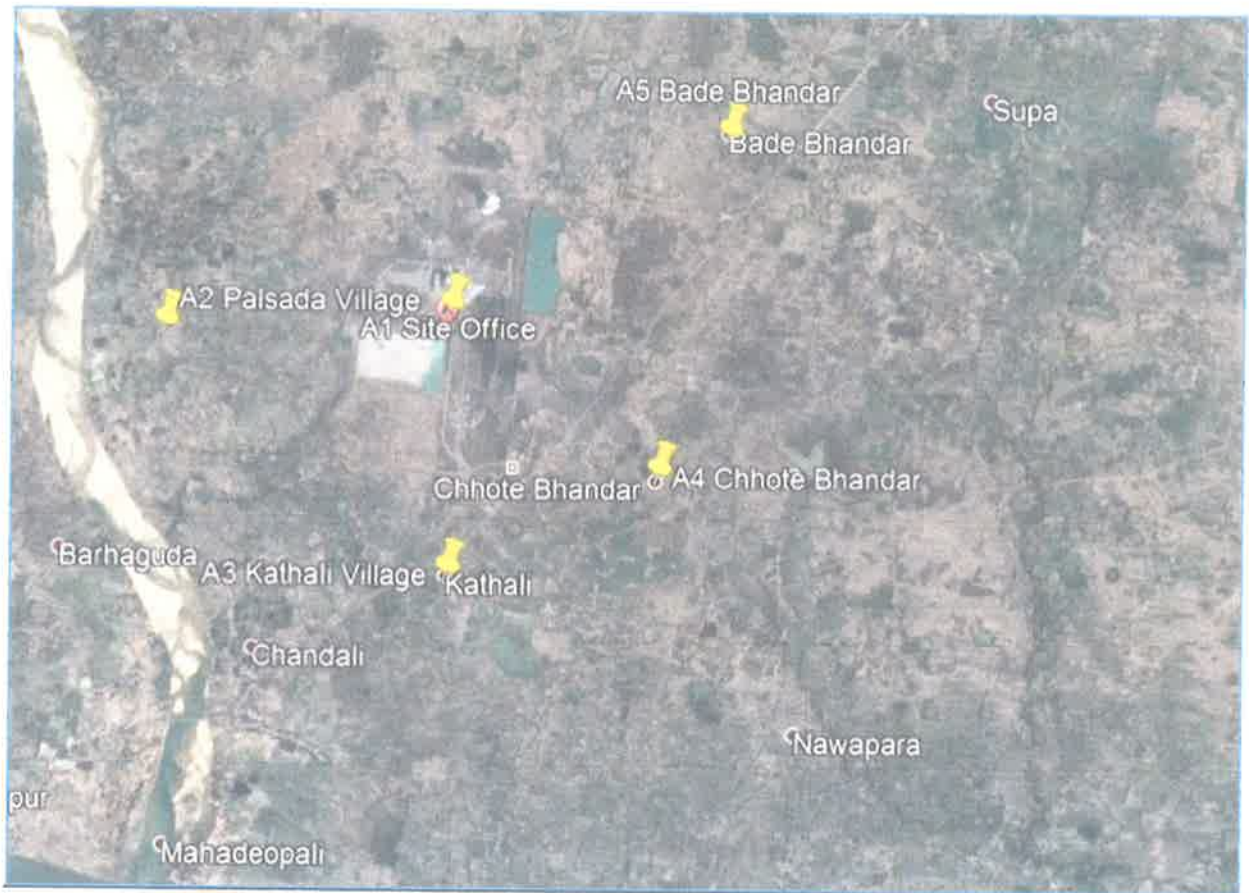


Figure No.3. Plan Showing Ambient Air Quality Location Map

- Location Code: -
- A1- Site Office
 - A2- PalsadaVillage
 - A3- Kathali Village
 - A4- Chote Bhandar Village
 - A5- Bade Bhandar Village



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/01 Report No.: VEL/A/1802/001
 Name & Address of the Party: M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh) Format No.: 5.10 F-01
 Party Reference No.: NIL
 Reporting Date: 10/03/2018
 Receipt Date: 03/03/2018 Period of Analysis: 03-09/03/2018

Sample Description: AMBIENT AIR QUALITY MONITORING

General Information:-

Client Representative : Mr. Amit Soni
 Sample collected by : Vardan Enviro Lab Representative
 Sampling Location : Site Office
 Instrument Used : RDS & FPS sampler with all Accessories
 Instrument Code : VEL/RDS/06 & VEL/FPS/06
 Instrument Calibration Status : Calibrated
 Meteorological condition during monitoring : Clear Sky
 Date of Monitoring : 28/02/2018 to 01/03/2018
 Time of Monitoring : 24 hours
 Ambient Temperature (°C) : Min. 20.0 Max. 32.0
 Surrounding Activity : Human and Vehicular activities
 Scope of Monitoring : Regulatory Requirement
 Control measure if Any : ---
 Sampling & Analysis Protocol : IS-5182
 Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	*SOP No. VEL/SOP/01, Section No. SP 63	40.3	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	79.5	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	21.4	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	12.3	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.84	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS – National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.

SOP- Laboratory Standard Operating Procedure.


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/02 **Report No.:** VEL/A/1802/002
Name & Address of the Party: M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh) **Format No.:** 5.10 F-01
Party Reference No.: NIL
Reporting Date: 10/03/2018
Receipt Date: 03/03/2018 **Period of Analysis:** 03-09/03/2018

Sample Description: AMBIENT AIR QUALITY MONITORING

General Information:-

Client Representative : Mr. Amit Soni
Sample collected by : Vardan Enviro Lab Representative
Sampling Location : Village Palsada
Instrument Used : RDS & FPS sampler with all Accessories
Instrument Code : VEL/RDS/07 & VEL/FPS/07
Instrument Calibration Status : Calibrated
Meteorological condition during monitoring : Clear Sky
Date of Monitoring : 26/02/2018 to 27/02/2018
Time of Monitoring : 24 hours
Ambient Temperature (°C) : Min. 20.0 Max. 35.0
Surrounding Activity : Human and Vehicular activities
Scope of Monitoring : Regulatory Requirement
Control measure if Any : ---
Sampling & Analysis Protocol : IS-5182
Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	#SOP No. VEL/SOP/01, Section No. SP 63	41.5	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	74.2	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	20.7	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	8.5	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.74	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS – National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.

SOP- Laboratory Standard Operating Procedure.

Shishir
(Tested By)

Manita
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/03 Report No.: VEL/A/1802/003
 Name & Address of the Party: M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh) Format No.: 5.10 F-01
 Party Reference No.: NIL
 Reporting Date: 10/03/2018
 Receipt Date: 03/03/2018 Period of Analysis: 03-09/03/2018

Sample Description: AMBIENT AIR QUALITY MONITORING

General Information:-

Client Representative : Mr. Amit Soni
 Sample collected by : Vardan Enviro Lab Representative
 Sampling Location : Village Kathli
 Instrument Used : RDS & FPS sampler with all Accessories
 Instrument Code : VEL/RDS/08 & VEL/FPS/08
 Instrument Calibration Status : Calibrated
 Meteorological condition during monitoring : Clear Sky
 Date of Monitoring : 27/02/2018 to 28/02/2018
 Time of Monitoring : 24 hours
 Ambient Temperature (°C) : Min. 18.0 Max. 35.0
 Surrounding Activity : Human and Vehicular activities
 Scope of Monitoring : Regulatory Requirement
 Control measure if Any : ---
 Sampling & Analysis Protocol : IS-5182
 Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	*SOP No. VEL/SOP/01, Section No. SP 63	42.5	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	74.1	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	25.7	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	8.0	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.72	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS - National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.

SOP- Laboratory Standard Operating Procedure.

Sheela
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/04 Report No.: VEL/A/1802/004
 Name & Address of the Party: M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh) Format No.: 5.10 F-01
 Party Reference No.: NIL
 Reporting Date: 10/03/2018
 Receipt Date: 03/03/2018 Period of Analysis: 03-09/03/2018

Sample Description: AMBIENT AIR QUALITY MONITORING

General Information:-

Client Representative : Mr. Amit Soni
 Sample collected by : Vardan Enviro Lab Representative
 Sampling Location : Village Chhote Bhandar
 Instrument Used : RDS & FPS sampler with all Accessories
 Instrument Code : VEL/RDS/09 & VEL/FPS/09
 Instrument Calibration Status : Calibrated
 Meteorological condition during monitoring : Clear Sky
 Date of Monitoring : 27/02/2018 to 28/02/2018
 Time of Monitoring : 24 hours
 Ambient Temperature (°C) : Min. 18.0 Max. 35.0
 Surrounding Activity : Human and Vehicular activities
 Scope of Monitoring : Regulatory Requirement
 Control measure if Any : ---
 Sampling & Analysis Protocol : IS-5182
 Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	#SOP No. VEL/SOP/01, Section No. SP 63	39.6	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	80.2	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	21.7	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	10.3	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.87	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS – National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.
 # SOP- Laboratory Standard Operating Procedure.

Shishu
 (Tested By)

Manita
 (Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/A/05 Report No.: VEL/A/1802/005
 Name & Address of the Party: M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh) Format No.: 5.10 F-01
 Party Reference No.: NIL
 Reporting Date: 10/03/2018
 Receipt Date: 03/03/2018 Period of Analysis: 03-09/03/2018

Sample Description: AMBIENT AIR QUALITY MONITORING

General Information:-

Client Representative : Mr. Amit Soni
 Sample collected by : Vardan Enviro Lab Representative
 Sampling Location : Village Bade Bhandar
 Instrument Used : RDS & FPS sampler with all Accessories
 Instrument Code : VEL/RDS/10 & VEL/FPS/10
 Instrument Calibration Status : Calibrated
 Meteorological condition during monitoring : Clear Sky
 Date of Monitoring : 27/02/2018 to 28/02/2018
 Time of Monitoring : 24 hours
 Ambient Temperature (°C) : Min. 18.0 Max. 35.0
 Surrounding Activity : Human and Vehicular activities
 Scope of Monitoring : Regulatory Requirement
 Control measure if Any : ---
 Sampling & Analysis Protocol : IS-5182
 Parameter Required : PM_{2.5}, PM₁₀, NO_x, SO₂, CO, Hg

S. No.	Parameter	Protocol	Result	Unit	NAAQS* Limit
1.	Particulate Matter (PM _{2.5})	"SOP No. VEL/SOP/01, Section No. SP 63	44.2	µg/m ³	60
2.	Particulate Matter (PM ₁₀)	IS: 5182 (P-23), 2006	81.5	µg/m ³	100
3.	Nitrogen Dioxide (NO ₂)	IS: 5182 (P-6), Reaffirmed-2006	25.9	µg/m ³	80
4.	Sulphur Dioxide (SO ₂)	IS: 5182 (P-2), Reaffirmed-2012	8.7	µg/m ³	80
5.	Carbon Monoxide (CO)	IS: 5182 (P-10), Reaffirmed-2003	0.78	mg/m ³	4
6.	Mercury as Hg	CPCB Guidelines	BDL	ng/m ³	--

* NAAQS – National Ambient Air Quality Standards; Schedule-VII, [Rule 3 (3B)], [Part-II-sec.-3(i)] 18.11.2009.

SOP- Laboratory Standard Operating Procedure.


 (Tested By)


 (Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Third Quarter Environmental Monitoring

4.2 Noise Level Monitoring



Figure No.4. Plan Showing Noise Level Monitoring Location Map

Ambient Noise Level Monitoring Locations

- Location Code: -
- N1- Field Hostel
 - N2- PalsadaVillage
 - N3- Kathali Village
 - N4- Chote Bhandar Village
 - N5- Bade Bhandar Village

Work Zone Noise Level Monitoring Locations

- Location Code: -
- N6- Site Office
 - N7- Behind Switchyard
 - N8- Railway Entry Gate



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/AN/01	Report No.:	VEL/AN/1712/001
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	28/12/2017
		Receipt Date:	25/12/2017

Sample Description: AMBIENT NOISE LEVEL MONITORING

General Information:-	
Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Representative
Sampling Location	: Field Hostel
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/09
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 21/12/2017 to 22/12/2017
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min 12.8 Max 27.8
Surrounding Activity	: Human and Vehicular Activities
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L _{max}	IS 9989 R-2003	62.1	52.1	dB(A)
2.	L _{min}	IS 9989 R-2003	40.2	35.2	dB(A)
3.	L _{eq}	IS 9989 R-2003	51.52	44.30	dB(A)
4.	CPCB Limits in dB(A*) Leq (Industrial Area)	-	75.00	70.00	dB(A)

Note *A "decibel" is a unit in which noise is measured.

Sushant
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/AN/02	Report No.:	VEL/AN/1712/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	28/12/2017
		Receipt Date:	25/12/2017

Sample Description: AMBIENT NOISE LEVEL MONITORING

General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Representative
Sampling Location	: Village Palsada
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/10
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 21/12/2017 to 22/12/2017
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min 12.0 Max 27.1
Surrounding Activity	: Human and Vehicular Activities
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L _{max}	IS 9989 R-2003	60.2	50.2	dB(A)
2.	L _{min}	IS 9989 R-2003	41.3	35.4	dB(A)
3.	L _{eq}	IS 9989 R-2003	50.21	40.70	dB(A)
4.	CPCB Limits in dB(A) ⁺ Leq (Residential Area)	-	55.00	45.00	dB(A)

Note * A "decibel" is a unit in which noise is measured.


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/AN/03	Report No.:	VEL/AN/1712/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	28/12/2017
		Receipt Date:	25/12/2017

Sample Description: AMBIENT NOISE LEVEL MONITORING

General Information:-	
Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Representative
Sampling Location	: Village Kathli
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/11
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 21/12/2017 to 22/12/2017
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min 13.4 Max 27.9
Surrounding Activity	: Human and Vehicular Activities
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L _{max}	IS 9989 R-2003	58.5	49.2	dB(A)
2.	L _{min}	IS 9989 R-2003	40.8	33.4	dB(A)
3.	L _{eq}	IS 9989 R-2003	51.30	38.74	dB(A)
4.	CPCB Limits in dB(A*) Leq (Residential Area)	-	55.00	45.00	dB(A)

Note * A "decibel" is a unit in which noise is measured.

Shishir
(Tested By)

Navika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/AN/04	Report No.:	VEL/AN/1712/004
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	28/12/2017
		Receipt Date:	25/12/2017

Sample Description: AMBIENT NOISE LEVEL MONITORING


General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Representative
Sampling Location	: Village Chhote Bhandar
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/12
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 21/12/2017 to 22/12/2017
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min 13.8 Max 27.6
Surrounding Activity	: Human and Vehicular Activities
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L _{max}	IS 9989 R-2003	57.2	45.4	dB(A)
2.	L _{min}	IS 9989 R-2003	38.7	30.2	dB(A)
3.	L _{eq}	IS 9989 R-2003	50.85	40.65	dB(A)
4.	CPCB Limits in dB(A) Leq (Residential Area)	-	55.00	45.00	dB(A)

Note * A "decibel" is a unit in which noise is measured.


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/AN/05	Report No.:	VEL/AN/1712/005
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	28/12/2017
		Receipt Date:	25/12/2017


Sample Description: AMBIENT NOISE LEVEL MONITORING

General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Representative
Sampling Location	: Village Bade Bhandar
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/13
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 21/12/2017 to 22/12/2017
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min 13.7 Max 27.6
Surrounding Activity	: Human and Vehicular Activities
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L _{max}	IS 9989 R-2003	55.7	42.0	dB(A)
2.	L _{min}	IS 9989 R-2003	39.4	37.6	dB(A)
3.	L _{eq}	IS 9989 R-2003	49.80	38.80	dB(A)
4.	CPCB Limits in dB(A) [*] Leq (Residential Area)	-	55.00	45.00	dB(A)

Note: * A "decibel" is a unit in which noise is measured.


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the Invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/N/01 **Report No.:** VEL/N/1712/001
Name & Address of the Party: M/s Korba West Power Company **Format No.:** 5.10 F-01
Limited Village Chhote Bhandar, Post **Party Reference No.:** NIL
office Bade Bhandar, Tehsil Pussore, **Reporting Date:** 28/12/2017
Dist.-Raigarh -496100 (Chhattisgarh) **Receipt Date:** 25/12/2017

Sample Description: WORK ZONE NOISE LEVEL MONITORING

General Information:-

Client Representative : Mr. Amit Soni
Sample collected by : Vardan EnviroLab Team
Sampling Location : Site Office
Instrument Used : Sound Level Meter
Instrument Code : VEL/S/SLM/01
Instrument Calibration Status : Calibrated
Meteorological condition during monitoring : Clear Sky
Date of Monitoring : 22/12/2017
Time of Monitoring : 09:00 AM to 09:30AM
Ambient Temperature (°C) : Min 15.0 Max 25.6
Scope of Monitoring : Regulatory Requirement
Control measure if Any : No any
Sampling & Analysis Protocol : IS-9989 R-2003
Sampling Duration : 24 Hours
Parameter Required : As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)	Unit
1.	L _{eq}	IS 9989 R-2003	60.58	dB(A)
2.	Limits in dB(A) Leq		85	dB(A)

Note * A "decibel" is a unit in which noise is measured.


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced, wholly or in part and cannot be used as evidence in the court of law

Page 1 of 1



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/N/02	Report No.:	VEL/N/1712/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	28/12/2017
		Receipt Date:	25/12/2017

Sample Description: WORK ZONE NOISE LEVEL MONITORING

General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Team
Sampling Location	: Behind Switchyard
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/01
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 22/12/2017
Time of Monitoring	: 10:00 AM to 10:30AM
Ambient Temperature (°C)	: Min 16.0 Max 26.1
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)	Unit
1.	L _{eq}	IS 9989 R-2003	68.42	dB(A)
2.	Limits in dB(A) Leq	-	85	dB(A)

Note: * A "decibel" is a unit in which noise is measured.

(Tested By)

(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/N/03	Report No.:	VEL/N/1712/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	28/12/2017
		Receipt Date:	25/12/2017

Sample Description: WORK ZONE NOISE LEVEL MONITORING

General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Team
Sampling Location	: Railway Entry Gate
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/01
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 22/12/2017
Time of Monitoring	: 11:00 AM to 11:30AM
Ambient Temperature (°C)	: Min 18.7 Max 27.0
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)	Unit
1.	L _{eq}	IS 9989 R-2003	70.45	dB(A)
2.	Limits in dB(A*) Leq	-	85	dB(A)

Note * A "decibel" is a unit in which noise is measured.

S. Shrivastava
(Tested By)

Manish
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Fourth Quarter Environmental Monitoring

4.2 Noise Level Monitoring



Figure No.4. Plan Showing Noise Level Monitoring Location Map

Ambient Noise Level Monitoring Locations

- Location Code: -
- N1- Field Hostel
 - N2- Palsada Village
 - N3- Kathali Village
 - N4- Chote Bhandar Village
 - N5- Bade Bhandar Village

Work Zone Noise Level Monitoring Locations

- Location Code: -
- N6- Site Office
 - N7- Behind Switchyard
 - N8- Railway Entry Gate



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/AN/01 Report No.: VEL/AN/1802/001
 Name & Address of the Party: M/s Korba West Power Company Format No.: 5.10 F-01
 Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh) Party Reference No.: NIL
 Reporting Date: 10/03/2018
 Receipt Date: 03/03/2018

Sample Description: AMBIENT NOISE LEVEL MONITORING

General Information:-

Client Representative : Mr. Amit Soni
 Sample collected by : Vardan EnviroLab Representative
 Sampling Location : Field Hostel
 Instrument Used : Sound Level Meter
 Instrument Code : VEL/S/SLM/09
 Instrument Calibration Status : Calibrated
 Meteorological condition during monitoring : Clear Sky
 Date of Monitoring : 26/02/2018 to 27/02/2018
 Time of Monitoring : 06:00 AM to 06:00AM
 Ambient Temperature (°C) : Min. 20.0 Max. 35.0
 Surrounding Activity : Human and Vehicular Activities
 Scope of Monitoring : Regulatory Requirement
 Control measure if Any : No any
 Sampling & Analysis Protocol : IS-9989 R-2003
 Sampling Duration : 24 Hours
 Parameter Required : As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L _{max}	IS 9989 R-2003	61.8	51.7	dB(A)
2.	L _{min}	IS 9989 R-2003	41.3	36.5	dB(A)
3.	L _{eq}	IS 9989 R-2003	52.31	44.92	dB(A)
4.	CPCB Limits in dB(A*) Leq (Industrial Area)	-	75.00	70.00	dB(A)

Note * A "decibel" is a unit in which noise is measured.

Shishir
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/AN/02	Report No.:	VEL/AN/1802/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	10/03/2018
		Receipt Date:	03/03/2018

Sample Description: AMBIENT NOISE LEVEL MONITORING

General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Representative
Sampling Location	: Village Palsada
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/10
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 26/02/2018 to 27/02/2018
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min. 20.0 Max. 35.0
Surrounding Activity	: Human and Vehicular Activities
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L _{max}	IS 9989 R-2003	61.3	51.4	dB(A)
2.	L _{min}	IS 9989 R-2003	42.8	34.7	dB(A)
3.	L _{eq}	IS 9989 R-2003	51.24	41.55	dB(A)
4.	CPCB Limits in dB(A) ¹ Leq (Residential Area)	-	55.00	45.00	dB(A)

Note * A "decibel" is a unit in which noise is measured.

S. Srivastava
(Tested By)

Muniba
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/AN/03	Report No.:	VEL/AN/1802/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	10/03/2018
		Receipt Date:	03/03/2018

Sample Description: AMBIENT NOISE LEVEL MONITORING

General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Representative
Sampling Location	: Village Kathli
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/11
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 27/02/2018 to 28/02/2018
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min. 18.0 Max. 35.0
Surrounding Activity	: Human and Vehicular Activities
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L _{max}	IS 9989 R-2003	57.9	48.5	dB(A)
2.	L _{min}	IS 9989 R-2003	41.3	34.2	dB(A)
3.	L _{eq}	IS 9989 R-2003	51.88	39.52	dB(A)
4.	CPCB Limits in dB(A*) Leq (Residential Area)	-	55.00	45.00	dB(A)

Note: * A "decibel" is a unit in which noise is measured.

Shrisha
(Tested By)

Kumika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/AN/04	Report No.:	VEL/AN/1802/004
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	10/03/2018
		Receipt Date:	03/03/2018


Sample Description: AMBIENT NOISE LEVEL MONITORING


General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Representative
Sampling Location	: Village Chhote Bhandar
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/12
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 27/02/2018 to 28/02/2018
Time of Monitoring	: 06:00 AM to 06:00AM
Ambient Temperature (°C)	: Min. 18.0 Max. 35.0
Surrounding Activity	: Human and Vehicular Activities
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L _{max}	IS 9989 R-2003	56.4	44.3	dB(A)
2.	L _{min}	IS 9989 R-2003	39.8	31.5	dB(A)
3.	L _{eq}	IS 9989 R-2003	51.42	41.84	dB(A)
4.	CPCB Limits in dB(A*) Leq (Residential Area)	-	55.00	45.00	dB(A)

Note * A "decibel" is a unit in which noise is measured.


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/AN/05 Report No.: VEL/AN/1802/005
Name & Address of the Party: M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh) Format No.: 5.10 F-01
Party Reference No.: NIL
Reporting Date: 10/03/2018
Receipt Date: 03/03/2018

Sample Description: AMBIENT NOISE LEVEL MONITORING

General Information:-

Client Representative : Mr. Amit Soni
Sample collected by : Vardan EnviroLab Representative
Sampling Location : Village Bade Bhandar
Instrument Used : Sound Level Meter
Instrument Code : VEL/S/SLM/13
Instrument Calibration Status : Calibrated
Meteorological condition during monitoring : Clear Sky
Date of Monitoring : 27/02/2018 to 28/02/2018
Time of Monitoring : 06:00 AM to 06:00AM
Ambient Temperature (°C) : Min. 18.0 Max. 35.0
Surrounding Activity : Human and Vehicular Activities
Scope of Monitoring : Regulatory Requirement
Control measure if Any : No any
Sampling & Analysis Protocol : IS-9989 R-2003
Sampling Duration : 24 Hours
Parameter Required : As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)		Unit
			Day Time (6:00 am to 10:00 pm)	Night Time (10:00 pm to 06:00 am)	
1.	L_{max}	IS 9989 R-2003	56.2	43.6	dB(A)
2.	L_{min}	IS 9989 R-2003	40.2	36.5	dB(A)
3.	L_{eq}	IS 9989 R-2003	48.51	39.55	dB(A)
4.	CPCB Limits in dB(A*) L_{eq} (Residential Area)	-	55.00	45.00	dB(A)

Note * A "decibel" is a unit in which noise is measured.

Shreshth
(Tested By)

Mamika
(Checked By)

B
(Approved By)

NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Page 1 of 1



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/N/01	Report No.:	VEL/N/1802/001
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	10/03/2018
		Receipt Date:	03/03/2018

Sample Description: WORK ZONE NOISE LEVEL MONITORING

General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Team
Sampling Location	: Site Office
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/01
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 28/02/2018
Time of Monitoring	: 09:00 AM to 09:30AM
Ambient Temperature (°C)	: Min. 20.0 Max. 32.0
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)	Unit
1.	L _{eq}	IS 9989 R-2003	59.41	dB(A)
2.	Limits in dB(A) Leq	-	85	dB(A)

Note * A "decibel" is a unit in which noise is measured.

Shreshth
(Tested By)

Mamika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/N/02	Report No.:	VEL/N/1802/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	10/03/2018
		Receipt Date:	03/03/2018

Sample Description: WORK ZONE NOISE LEVEL MONITORING

General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Team
Sampling Location	: Behind Switchyard
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/01
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 27/02/2018
Time of Monitoring	: 10:00 AM to 10:30AM
Ambient Temperature (°C)	: Min. 18.0 Max. 35.0
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)	Unit
1.	L _{eq}	IS 9989 R-2003	67.88	dB(A)
2.	Limits in dB(A) Leq	-	85	dB(A)

Note * A "decibel" is a unit in which noise is measured.

Shreshth
(Tested By)

Manish
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/N/03	Report No.:	VEL/N/1802/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
		Party Reference No.:	NIL
		Reporting Date:	10/03/2018
		Receipt Date:	03/03/2018

Sample Description: WORK ZONE NOISE LEVEL MONITORING

General Information:-

Client Representative	: Mr. Amit Soni
Sample collected by	: Vardan EnviroLab Team
Sampling Location	: Railway Entry Gate
Instrument Used	: Sound Level Meter
Instrument Code	: VEL/S/SLM/01
Instrument Calibration Status	: Calibrated
Meteorological condition during monitoring	: Clear Sky
Date of Monitoring	: 28/02/2018
Time of Monitoring	: 11:00 AM to 11:30AM
Ambient Temperature (°C)	: Min. 20.0 Max. 32.0
Scope of Monitoring	: Regulatory Requirement
Control measure if Any	: No any
Sampling & Analysis Protocol	: IS-9989 R-2003
Sampling Duration	: 24 Hours
Parameter Required	: As per Work Order

S. No.	Parameters	Protocol	Test Result dB (A)	Unit
1.	L_{eq}	IS 9989 R-2003	71.05	dB(A)
2.	Limits in dB(A) L_{eq}	-	85	dB(A)

Note: * A "decibel" is a unit in which noise is measured.


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Third Quarter Environmental Monitoring 4.3 Ground water Quality Analysis



Figure No.5. Plan Showing Ground Water Quality Monitoring Location Map

Location Code: -

- GW1- Site Office**
- GW2- PalsadaVillage**
- GW3- Kthali Village**
- GW4- Chote Bhandar Village**
- GW5- Bade Bhandar Village**



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/01	Report No.:	VEL/W/1712/001
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Site Office	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	25/12/2017-27/12/2017
Preservation:	Refrigerated	Receipt Date:	25/12/2017
Parameter Required:	As per IS 10500-2012	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS: 10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.10	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5 Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	104.5	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	25.10	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	73.57	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	26.17	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl ⁻ B	*BDL (**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL (**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	10.18	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	133.0	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	13.8	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.31	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	0.20	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.16	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL (**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL (**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL (**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Sushant
(Tested By)

Munika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/01		Report No:		VEL/W/1712/001	
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012		
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source	
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002	
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0	
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15	
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5	
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mmg/l)	mg/l	0.1	0.3	
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation	
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation	
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation	
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05	
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation	
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		

Note: - *BDL-Below Detection Limit, **DL- Detection Limit

Shishir
(Tested By)

Manish
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Page 2 of 2



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/02	Report No.:	VEL/W/1712/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Village Palsada	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	25/12/2017-27/12/2017
Preservation:	Refrigerated	Receipt Date:	25/12/2017
Parameter Required:	As per IS 10500-2012	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS:10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.63	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	142.5	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	60.20	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	253.6	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	16.21	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl ⁻ B	*BDL(**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	1.87	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	266.0	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	10.08	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.40	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	0.32	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.23	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Sheelika
(Tested By)

Munika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/02		Report No:		VEL/W/1712/002	
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012		
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source	
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002	
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0	
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15	
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5	
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.1	0.3	
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation	
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation	
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation	
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05	
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation	
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Page 2 of 2



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/03	Report No.:	VEL/W/1712/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Village Kathli	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	25/12/2017-27/12/2017
Preservation:	Refrigerated	Receipt Date:	25/12/2017
Parameter Required:	As per IS 10500-2012	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS:10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.48	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	578.6	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	120.2	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	210.3	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	65.48	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl ⁻ B	*BDL(**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	67.72	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	615.0	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	48.20	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.67	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	3.13	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.26	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Shrishti
(Tested By)

Mamika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Sample No.:		VEL/KWPCL/West Certificate			VEL/W/1712/003	
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012	
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mmg/l)	mg/l	0.1	0.3
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	

Note: - *BDL-Below Detection Limit, **DL- Detection Limit

#These parameter are not covered in our NABL scope.


(Tested By)


(Checked By)



NOTE: a)The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Sample Number:	VEL/KWPCL/W/04	Test Certificate Report No.:	VEL/W/1712/004
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Village Chhote Bhandar	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	25/12/2017-27/12/2017
Preservation:	Refrigerated	Receipt Date:	25/12/2017
Parameter Required:	As per IS 10500-2012	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS:10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.49	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	265.8	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	86.31	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	187.3	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl B	84.20	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	*BDL(**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	12.26	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	390.0	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	39.87	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F D	0.42	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	3.01	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.23	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Schishki
(Tested By)

Muniya
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)


Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Sample No.:		VEL/KWPCL/West Certificate			VEL/W/1712/004	
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012	
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.1	0.3
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	

Note: - *BDL-Below Detection Limit, **DL- Detection Limit

#These parameter are not covered in our NABL scope.


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Page 2 of 2



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Sample Number:	VEL/KWPCL/W/05	Test Certificate Report No.:	VEL/W/1712/005
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Village Bade Bhandar	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	25/12/2017-27/12/2017
Preservation:	Refrigerated	Receipt Date:	25/12/2017
Parameter Required:	As per IS 10500-2012	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS:10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.87	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	230.41	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	91.32	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	252.2	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	35.10	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl ⁻ B	*BDL(**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	0.63	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	346.0	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	12.09	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.38	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	3.20	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.24	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Schriষ্ঠi
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Sample No.:		VEL/KWPCL/West Certificate			VEL/W/1712/005	
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012	
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.1	0.3
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	

Note: - *BDL-Below Detection Limit, **DL- Detection Limit

#These parameter are not covered in our NABL scope.

Shishil
(Tested By)

Munika
(Checked By)



NOTE: a)The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

**Fourth Quarter Environmental Monitoring
4.3 Ground water Quality Analysis**



Figure No.5. Plan Showing Ground Water Quality Monitoring Location Map

Location Code: -

- GW1- Site Office
- GW2- Palsada Village
- GW3- Kthali Village
- GW4- Chote Bhandar Village
- GW5- Bade Bhandar Village



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)


Test Certificate

Sample Number:	VEL/KWPCL/W/01	Report No.:	VEL/W/1802/001
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Site Office	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS: 10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.19	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	123.4	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	28.41	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	78.52	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	27.44	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl ⁻ B	*BDL (**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL (**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	12.76	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	145	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	15.4	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.33	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	0.22	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.12	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL (**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL (**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL (**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

S. Prakash
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/01	Report No:		VEL/W/1802/001	
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012	
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.1	0.3
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	

Note: - *BDL-Below Detection Limit, **DL- Detection Limit

Shreshth
(Tested By)

Manita
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Page 2 of 2



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/02	Report No.:	VEL/W/1802/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Village Palsada	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	26/02/2018
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS: 10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.69	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0. 1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	132.4	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	50.22	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	241.3	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	18.91	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl ⁻ B	*BDL(**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	1.72	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	248	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	9.27	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F D	0.41	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	0.30	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.21	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Shishir
(Tested By)

Munika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/02	Report No: VEL/W/1802/002			
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012	
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.1	0.3
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	

Note: - *BDL-Below Detection Limit, **DL- Detection Limit

Shruti
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/03	Report No.:	VEL/W/1802/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Village Kathli	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS:10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.51	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	561.3	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	114.2	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	201.3	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	68.41	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	*BDL(**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	67.15	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	411	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	50.22	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.64	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	2.98	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.24	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Shreshth
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/03		Report No:		VEL/W/1802/003	
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012		
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source	
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002	
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0	
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15	
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5	
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.1	0.3	
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation	
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation	
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation	
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05	
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation	
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



NOTE: a)The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/04	Report No.:	VEL/W/1802/004
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Village Chhote Bhandar	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS:10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.32	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5 Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	253.4	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	83.21	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	165.8	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	86.93	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	*BDL(**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	11.13	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	359	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	42.33	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.39	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	3.06	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.20	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Shishu
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/04		Report No: VEL/W/1802/004		
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012	
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.1	0.3
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/05	Report No.:	VEL/W/1802/005
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	GROUND WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Village Bade Bhandar	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS:10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H* B	7.71	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	224.1	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	86.37	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	243.9	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl* B	31.55	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	*BDL (**DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN* D	*BDL (**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	2.09	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	312	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	13.52	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F* D	0.40	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	3.02	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.21	mg/l	0.3	No relaxation
18.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL (**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL (**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL (**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Shreshth
(Tested By)

Munika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/05		Report No: VEL/W/1802/005		
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012	
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mmg/l)	mg/l	0.1	0.3
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample	

Note: - *BDL-Below Detection Limit, **DL- Detection Limit
#These parameter are not covered in our NABL scope.

Shishu
(Tested By)

Munika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Third Quarter Environmental Monitoring

4.4 Surface water Quality Analysis



Figure. No. 6. Plan Showing Surface Water Quality Monitoring Location Map

Location Code: - 1. Mad- Mand Nadi River (Up Stream)

2. Mad- Mand Nadi River (Down Stream)



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/W/01
Name & Address of the Party: M/s Korba West Power Company Limited
Village ChhoteBhandar, Post office Bade Bhandar,
Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)
Report No.: VEL/W/1712/001
Format No.: 5.10 F-01
Party Reference No.: NIL
Reporting Date: 29/12/2017
Period of Analysis: 23/12/2017- 28/12/2017
Receipt Date: 23/12/2017
Sample Description: SURFACE WATER SAMPLE
Sample Location: Mand River (Down Stream)
Sample Collected by: VardanEnviroLab Representative
Preservation: Refrigerated
Parameter Required: As per IS 10500-2012
Sampling and Analysis Protocol: IS-10500-2012,APHA 22nd Edition 2012
Sampling Date: 22/12/2017
Sampling Quantity: 2.0 Ltr
Sampling Type: Grab

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.35	--
2.	Colour	APHA (22 nd Edition)2012, 2120 B	4.0	Hazen
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	3.5	NTU
4.	Chloride as Cl	APHA 22 nd Edition, 4500-Cl- B	33.51	mg/l
5.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	156.3	mg/l
6.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	55.40	mg/l
7.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	114.2	mg/l
8.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	7.5	mg/l
9.	COD	APHA 22 nd Edition 2012, 5220 B	28.9	mg/l
10.	Dissolved Oxygen	APHA 22 nd Edition 2012, 4500	6.8	mg/l
11.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	BDL(DL 0.2mg/l)	mg/l
12.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l
13.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	4.39	mg/l
14.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	215.0	mg/l
15.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	24.50	mg/l
16.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F D	0.21	mg/l
17.	Nitrate as NO ₃	IS 3025 (P-34) 2003	7.80	mg/l
18.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.20	mg/l
19.	Chromium as Cr ⁶⁺	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)


Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/01	Report No.:	
S. No	Parameter	Test-Method	Result	Unit
20.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l
21.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l
22.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	0.29	mg/l
23.	Oil & Grease	APHA 22 nd Edition, 5220 E	BDL	mg/l
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l
31.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
32.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



Page 2 of 2

NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/02	Report No.:	VEL/W/1712/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village ChhoteBhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SURFACE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Mand River (Up Stream)	Reporting Date:	29/12/2017
Sample Collected by:	VardanEnviroLab Representative	Period of Analysis:	23/12/2017- 28/12/2017
Preservation:	Refrigerated	Receipt Date:	23/12/2017
Parameter Required:	As per IS 10500-2012	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS-10500-2012,APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.54	--
2.	Colour	APHA (22 nd Edition)2012, 2120 B	5.0	Hazen
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	3.0	NTU
4.	Chloride as Cl	APHA 22 nd Edition, 4500-Cl- B	32.10	mg/l
5.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	145.0	mg/l
6.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	45.80	mg/l
7.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	102.3	mg/l
8.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	7.50	mg/l
9.	COD	APHA 22 nd Edition 2012, 5220 B	24.60	mg/l
10.	Dissolved Oxygen	APHA 22 nd Edition 2012, 4500	9.1	mg/l
11.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	BDL(DL 0.2mg/l)	mg/l
12.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l
13.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	7.46	mg/l
14.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	197.0	mg/l
15.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	29.50	mg/l
16.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F D	0.21	mg/l
17.	Nitrate as NO ₃	IS 3025 (P-34) 2003	7.2	mg/l
18.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.18	mg/l
19.	Chromium as Cr ⁶⁺	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404


(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/02	Report No.:		VEL/W/1712/002
S. No	Parameter	Test-Method	Result	Unit	
20.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	
21.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	
22.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	0.26	mg/l	
23.	Oil & Grease	APHA 22 nd Edition, 5220 E	BDL	mg/l	
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mmg/l)	mg/l	
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	
31.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	
32.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Fourth Quarter Environmental Monitoring

4.4 Surface water Quality Analysis



Figure. No. 6. Plan Showing Surface Water Quality Monitoring Location Map

Location Code: - 1. Mad- Mand Nadi River (Up Stream)

2. Mad- Mand Nadi River (Down Stream)



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/01	Report No.:	VEL/W/1802/001
Name & Address of the Party:	M/s Korba West Power Company Limited Village ChhoteBhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SURFACE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Mand River (Down Stream)	Reporting Date:	10/03/2018
Sample Collected by:	VardanEnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	26/02/2018
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.25	--
2.	Colour	APHA (22 nd Edition)2012, 2120 B	4.0	Hazen
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	3.2	NTU
4.	Chloride as Cl	APHA 22 nd Edition, 4500-Cl- B	35.16	mg/l
5.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	162.7	mg/l
6.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	52.91	mg/l
7.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	125.3	mg/l
8.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	8.2	mg/l
9.	COD	APHA 22 nd Edition 2012, 5220 B	30.0	mg/l
10.	Dissolved Oxygen	APHA 22 nd Edition 2012, 4500	7.1	mg/l
11.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	BDL(DL 0.2mg/l)	mg/l
12.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l
13.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	7.45	mg/l
14.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	220	mg/l
15.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	22.10	mg/l
16.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.25	mg/l
17.	Nitrate as NO ₃	IS 3025 (P-34) 2003	6.94	mg/l
18.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.22	mg/l
19.	Chromium as Cr ⁶⁺	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l

Shreshth
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/01	Report No.:	
S. No	Parameter	Test-Method	Result	Unit
20.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l
21.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l
22.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	0.27	mg/l
23.	Oil & Grease	APHA 22 nd Edition, 5220 E	BDL	mg/l
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l
31.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
32.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



Page 2 of 2

NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/02	Report No.:	VEL/W/1802/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village ChhoteBhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SURFACE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Mand River (Up Stream)	Reporting Date:	10/03/2018
Sample Collected by:	VardanEnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS-10500-2012,APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.43	--
2.	Colour	APHA (22 nd Edition)2012, 2120 B	5.0	Hazen
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	3.0	NTU
4.	Chloride as Cl	APHA 22nd Edition, 4500-Cl- B	30.10	mg/l
5.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	138.4	mg/l
6.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	42.91	mg/l
7.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	110.3	mg/l
8.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	8.40	mg/l
9.	COD	APHA 22nd Edition 2012, 5220 B	26.91	mg/l
10.	Dissolved Oxygen	APHA 22nd Edition 2012, 4500	8.7	mg/l
11.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	BDL(DL 0.2mg/l)	mg/l
12.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN' D	*BDL(**DL 0.02 mg/l)	mg/l
13.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	7.61	mg/l
14.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	201	mg/l
15.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	27.41	mg/l
16.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F' D	0.26	mg/l
17.	Nitrate as NO ₃	IS 3025 (P-34) 2003	7.0	mg/l
18.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.16	mg/l
19.	Chromium as Cr ⁶⁺	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l

S. Shrivastava
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/02	Report No.:		VEL/W/1802/002
S. No	Parameter	Test-Method	Result	Unit	
20.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	
21.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	
22.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	0.28	mg/l	
23.	Oil & Grease	APHA 22 nd Edition, 5220 E	BDL	mg/l	
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	
31.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	
32.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



NOTE: a)The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Third Quarter Environmental Monitoring



Figure. No. 7. Plan Showing Surface Water Quality Monitoring Location Map

Location Code: - 1 Mahanadi River Up Stream
2 Mahanadi River down Stream



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/03	Report No.:	VEL/W/1712/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village ChhoteBhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SURFACE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Mahanadi (Down Stream)	Reporting Date:	29/12/2017
Sample Collected by:	VardanEnviroLab Representative	Period of Analysis:	23/12/2017- 28/12/2017
Preservation:	Refrigerated	Receipt Date:	23/12/2017
Parameter Required:	As per IS 10500-2012	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS-10500-2012,APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.20	---
2.	Colour	APHA (22 nd Edition)2012, 2120 B	5.0	Hazen
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	4.0	NTU
4.	Chloride as Cl	APHA 22 nd Edition, 4500-Cl- B	19.50	mg/l
5.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	121.3	mg/l
6.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	20.50	mg/l
7.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	85.6	mg/l
8.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	8.5	mg/l
9.	COD	APHA 22 nd Edition 2012, 5220 B	24.60	mg/l
10.	Dissolved Oxygen	APHA 22 nd Edition 2012, 4500	8.2	mg/l
11.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	BDL(DL 0.2mg/l)	mg/l
12.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN D	*BDL(**DL 0.02 mg/l)	mg/l
13.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	17.04	mg/l
14.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	156.0	mg/l
15.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	23.45	mg/l
16.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F D	0.26	mg/l
17.	Nitrate as NO ₃	IS 3025 (P-34) 2003	8.1	mg/l
18.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.24	mg/l
19.	Chromium as Cr ⁶⁺	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l

(Signature)
(Tested By)

(Signature)
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/03		Report No.:		VEL/W/1712/003	
S. No	Parameter	Test-Method	Result	Unit			
20.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l			
21.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l			
22.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	0.28	mg/l			
23.	Oil & Grease	APHA 22 nd Edition, 5220 E	BDL	mg/l			
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l			
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l			
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l			
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l			
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l			
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l			
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l			
31.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l			
32.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l			

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/04	Report No.:	VEL/W/1712/004
Name & Address of the Party:	M/s Korba West Power Company Limited Village ChhoteBhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SURFACE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Mahanadi (Up Stream)	Reporting Date:	29/12/2017
Sample Collected by:	VardanEnviroLab Representative	Period of Analysis:	23/12/2017- 28/12/2017
Preservation:	Refrigerated	Receipt Date:	23/12/2017
Parameter Required:	As per IS 10500-2012	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS-10500-2012,APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.35	--
2.	Colour	APHA (22 nd Edition)2012, 2120 B	5.0	Hazen
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	3.0	NTU
4.	Chloride as Cl	APHA 22 nd Edition, 4500-Cl- B	15.2	mg/l
5.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	116.5	mg/l
6.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	15.40	mg/l
7.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	72.6	mg/l
8.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	6.4	mg/l
9.	COD	APHA 22 nd Edition 2012, 5220 B	22.10	mg/l
10.	Dissolved Oxygen	APHA 22 nd Edition 2012, 4500	9.4	mg/l
11.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	BDL(DL 0.2mg/l)	mg/l
12.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l
13.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	18.97	mg/l
14.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	131.0	mg/l
15.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	18.40	mg/l
16.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.20	mg/l
17.	Nitrate as NO ₃	IS 3025 (P-34) 2003	7.80	mg/l
18.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.17	mg/l
19.	Chromium as Cr ⁶⁺	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l

Schishki
(Tested By)

Manish
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/04	Report No.:	
S. No	Parameter	Test-Method	Result	Unit
20.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l
21.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l
22.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	0.26	mg/l
23.	Oil & Grease	APHA 22 nd Edition, 5220 E	BDL	mg/l
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l
31.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
32.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



Page 2 of 2

NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Fourth Quarter Environmental Monitoring



Figure. No. 7. Plan Showing Surface Water Quality Monitoring Location Map

Location Code: - 1 Mahanadi River Up Stream
 2 Mahanadi River down Stream



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/03	Report No.:	VEL/W/1802/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village ChhoteBhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SURFACE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Mahanadi (Down Stream)	Reporting Date:	10/03/2018
Sample Collected by:	VardanEnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	26/02/2018
Sampling and Analysis Protocol:	IS-10500-2012,APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.26	--
2.	Colour	APHA (22 nd Edition)2012, 2120 B	5.0	Hazen
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	4.0	NTU
4.	Chloride as Cl	APHA 22 nd Edition, 4500-Cl- B	20.38	mg/l
5.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	129.6	mg/l
6.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	22.05	mg/l
7.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	89.71	mg/l
8.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	9.3	mg/l
9.	COD	APHA 22 nd Edition 2012, 5220 B	22.83	mg/l
10.	Dissolved Oxygen	APHA 22 nd Edition 2012, 4500	7.4	mg/l
11.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	BDL(DL 0.2mg/l)	mg/l
12.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN' D	*BDL(**DL 0.02 mg/l)	mg/l
13.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	18.12	mg/l
14.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	164	mg/l
15.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	25.10	mg/l
16.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F' D	0.22	mg/l
17.	Nitrate as NO ₃	IS 3025 (P-34) 2003	8.9	mg/l
18.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.21	mg/l
19.	Chromium as Cr ⁶⁺	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l

Schishki
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample No.: VEL/KWPCL/W/03			Report No.: VEL/W/1802/003	
S. No	Parameter	Test-Method	Result	Unit
20.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l
21.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l
22.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	0.25	mg/l
23.	Oil & Grease	APHA 22 nd Edition, 5220 E	BDL	mg/l
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l
31.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
32.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/04	Report No.:	VEL/W/1802/004
Name & Address of the Party:	M/s Korba West Power Company Limited Village ChhotBhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SURFACE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Mahanadi (Up Stream)	Reporting Date:	10/03/2018
Sample Collected by:	VardanEnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	26/02/2018
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H* B	7.29	--
2.	Colour	APHA (22 nd Edition)2012, 2120 B	5.0	Hazen
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	3.0	NTU
4.	Chloride as Cl	APHA 22 nd Edition, 4500-Cl- B	19.2	mg/l
5.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	108.3	mg/l
6.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	16.72	mg/l
7.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	81.3	mg/l
8.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	7.3	mg/l
9.	COD	APHA 22 nd Edition 2012, 5220 B	20.61	mg/l
10.	Dissolved Oxygen	APHA 22 nd Edition 2012, 4500	8.7	mg/l
11.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl- B	BDL(DL 0.2mg/l)	mg/l
12.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN' D	*BDL(**DL 0.02 mg/l)	mg/l
13.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	16.18	mg/l
14.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	143	mg/l
15.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	20.3	mg/l
16.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F D	0.22	mg/l
17.	Nitrate as NO ₃	IS 3025 (P-34) 2003	7.91	mg/l
18.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.19	mg/l
19.	Chromium as Cr ⁶⁺	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l

Shreshth
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/04	Report No.:	
S. No	Parameter	Test-Method	Result	Unit
20.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l
21.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l
22.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	0.29	mg/l
23.	Oil & Grease	APHA 22 nd Edition, 5220 E	BDL	mg/l
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mmg/l)	mg/l
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l
28.	Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
29.	Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l
30.	Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l
31.	Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l
32.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



Page 2 of 2

NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Third Quarter Environmental Monitoring

4.5 Soil Quality Analysis

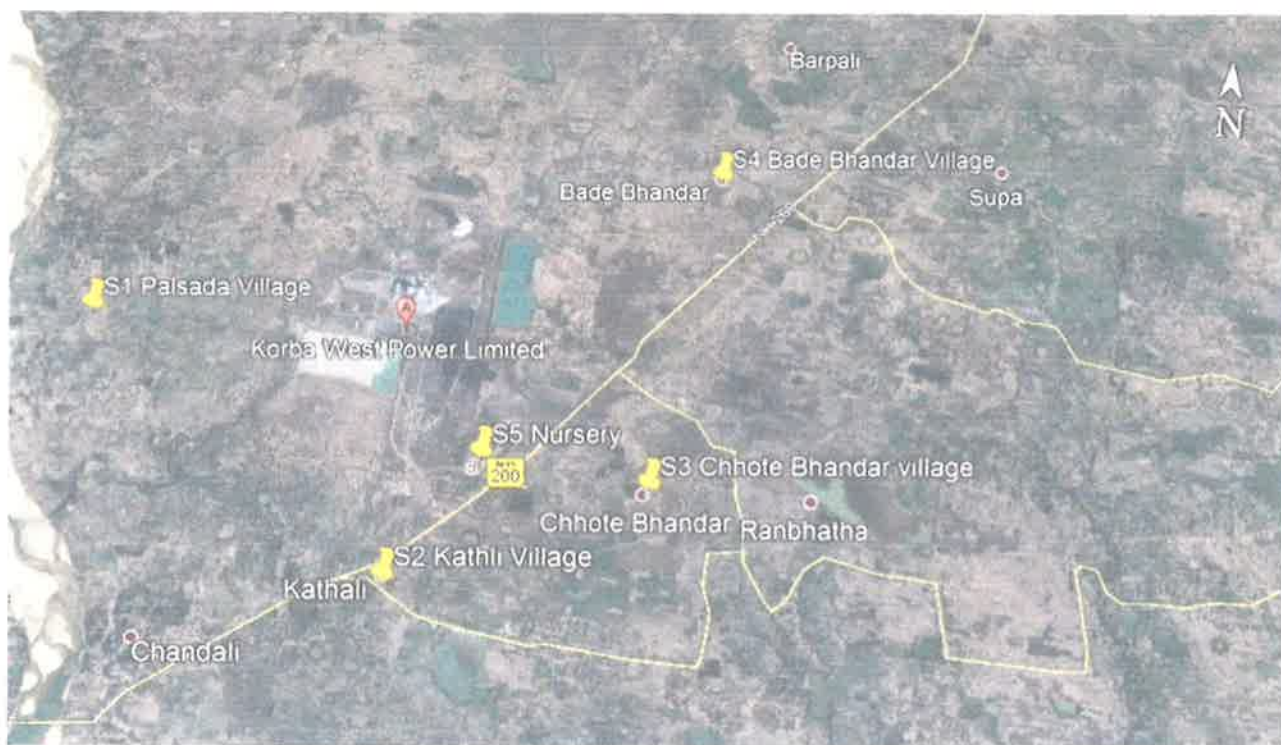


Figure No. 8. Plan Showing Soil Sample Monitoring Location Map

Location Code: -

- S1- PalsadaVillage**
- S2- Kthali Village**
- S3- Chote Bhandar Village**
- S4- Bade Bhandar Village**
- S5- Nursery**



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/S/01	Report No.:	VEL/ S/1712/001
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Village- Palsada	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	25/12/2017 to 27/12/2017
Packing Status:	Temp Sealed	Receipt Date:	25/12/2017
Parameter Required:	As per Work Order	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.12	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.376	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA 1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	33.10	%
6.	Bulk density	USDA Method, 1968	1.28	gm/cc
7.	Chloride as Cl	USDA Method, 1968	82.5	mg/kg
8.	Calcium as Ca	USDA Method, 1968	415.2	mg/kg
9.	Sodium as Na	USDA Method, 1968	78.5	mg/kg
10.	Potassium as K	USDA Method, 1968	120.1	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.73	%
12.	Magnesium as Mg	USDA Method, 1968	76.4	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	255.2	kg./hect.
14.	Available Phosphorus	USDA Method, 1968	28.5	kg./hect.
15.	Zinc (as Zn)	USEPA 3050B	21.2	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	211.3	mg/kg
17.	Lead (as Pb)	USEPA 3050B	8.1	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.82	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	3.8	mg/kg
20.	Copper (as Cu)	USEPA 3050B	18.2	mg/kg


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/S/02	Report No.:	VEL/ S/1712/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Village_ Kathli	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	25/12/2017 to 27/12/2017
Packing Status:	Temp Sealed	Receipt Date:	25/12/2017
Parameter Required:	As per Work Order	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.37	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.349	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	37.5	%
6.	Bulk density	USDA Method, 1968	1.30	gm/cc
7.	Chloride as Cl	USDA Method, 1968	59.98	mg/kg
8.	Calcium as Ca	USDA Method, 1968	380.5	mg/kg
9.	Sodium as Na	USDA Method, 1968	74.0	mg/kg
10.	Potassium as K	USDA Method, 1968	120.6	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.74	%
12.	Magnesium as Mg	USDA Method, 1968	65.63	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	253.6	kg./hect.
14.	Available Phosphorus	USDA Method, 1968	23.0	kg./hect.
15.	Zinc (as Zn)	USEPA 3050B	16.6	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	226.7	mg/kg
17.	Lead (as Pb)	USEPA 3050B	8.0	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.78	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	5.5	mg/kg
20.	Copper (as Cu)	USEPA 3050B	17.6	mg/kg


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/S/03	Report No.:	VEL/ S/1712/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Village-Chhote Bhandar	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	25/12/2017 to 27/12/2017
Packing Status:	Temp Sealed	Receipt Date:	25/12/2017
Parameter Required:	As per Work Order	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.51	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.328	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	29.52	%
6.	Bulk density	USDA Method, 1968	1.29	gm/cc
7.	Chloride as Cl	USDA Method, 1968	65.94	mg/kg
8.	Calcium as Ca	USDA Method, 1968	392.1	mg/kg
9.	Sodium as Na	USDA Method, 1968	61.3	mg/kg
10.	Potassium as K	USDA Method, 1968	123.1	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.71	%
12.	Magnesium as Mg	USDA Method, 1968	67.31	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	302.2	kg/hect.
14.	Available Phosphorus	USDA Method, 1968	23.6	kg/hect.
15.	Zinc (as Zn)	USEPA 3050B	17.2	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	208.5	mg/kg
17.	Lead (as Pb)	USEPA 3050B	9.6	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.81	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	3.2	mg/kg
20.	Copper (as Cu)	USEPA 3050B	17.7	mg/kg

(Signature)
(Tested By)

(Signature)
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/S/04	Report No.:	VEL/ S/1712/004
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Village-Bade Bhandar	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	25/12/2017 to 27/12/2017
Packing Status:	Temp Sealed	Receipt Date:	25/12/2017
Parameter Required:	As per Work Order	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.62	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.340	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	35.9	%
6.	Bulk density	USDA Method, 1968	1.32	gm/cc
7.	Chloride as Cl	USDA Method, 1968	52.08	mg/kg
8.	Calcium as Ca	USDA Method, 1968	475.2	mg/kg
9.	Sodium as Na	USDA Method, 1968	60.2	mg/kg
10.	Potassium as K	USDA Method, 1968	149.7	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.88	%
12.	Magnesium as Mg	USDA Method, 1968	81.06	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	317.5	kg./hect.
14.	Available Phosphorus	USDA Method, 1968	25.3	kg./hect.
15.	Zinc (as Zn)	USEPA 3050B	16.1	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	173.5	mg/kg
17.	Lead (as Pb)	USEPA 3050B	10.2	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.78	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	3.0	mg/kg
20.	Copper (as Cu)	USEPA 3050B	20.5	mg/kg

Shikhi
(Tested By)

Mamta
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law




Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCCL/S/05	Report No.:	VEL/ S/1712/005
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Nursery	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	25/12/2017 to 27/12/2017
Packing Status:	Temp Sealed	Receipt Date:	25/12/2017
Parameter Required:	As per Work Order	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.79	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.327	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	24.1	%
6.	Bulk density	USDA Method, 1968	1.38	gm/cc
7.	Chloride as Cl	USDA Method, 1968	61.32	mg/kg
8.	Calcium as Ca	USDA Method, 1968	288.2	mg/kg
9.	Sodium as Na	USDA Method, 1968	74.8	mg/kg
10.	Potassium as K	USDA Method, 1968	145.2	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.62	%
12.	Magnesium as Mg	USDA Method, 1968	61.05	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	260.8	kg./hect.
14.	Available Phosphorus	USDA Method, 1968	25.8	kg./hect.
15.	Zinc (as Zn)	USEPA 3050B	12.1	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	183.5	mg/kg
17.	Lead (as Pb)	USEPA 3050B	8.2	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.64	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	3.0	mg/kg
20.	Copper (as Cu)	USEPA 3050B	14.9	mg/kg


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Fourth Quarter Environmental Monitoring

4.5 Soil Quality Analysis

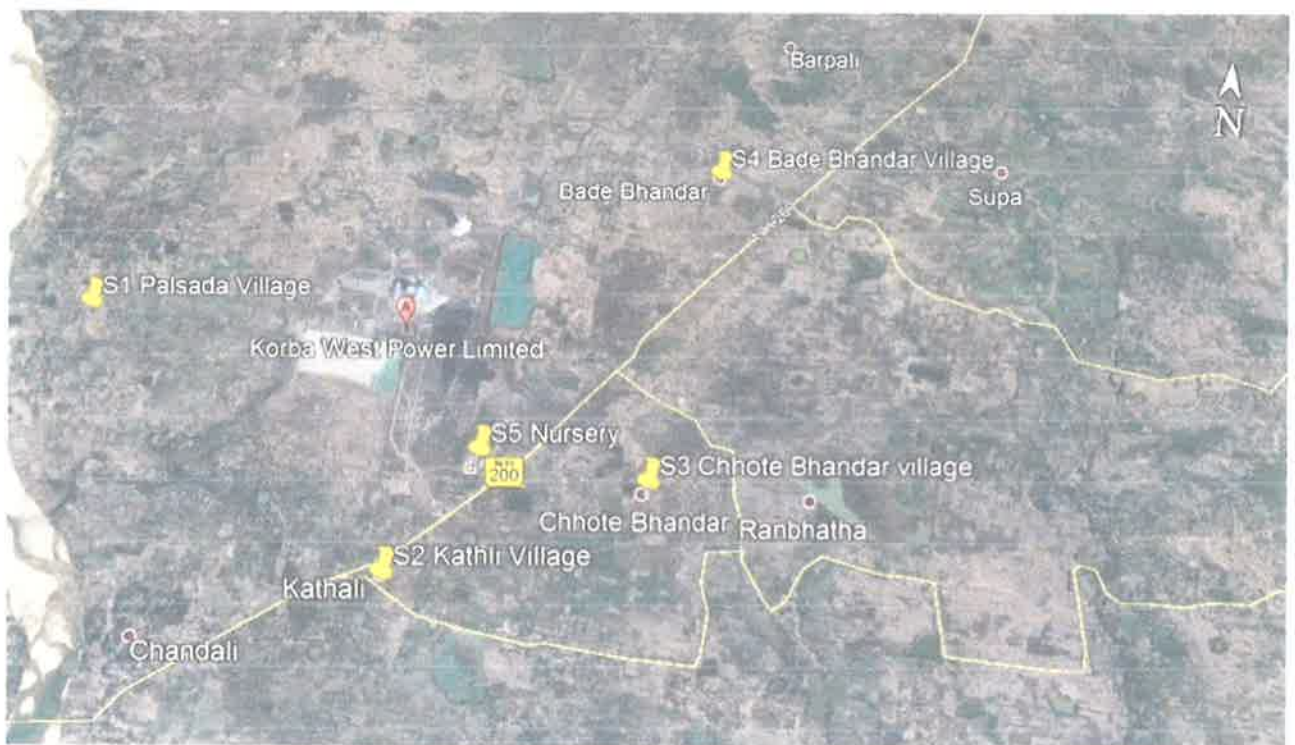


Figure No. 8. Plan Showing Soil Sample Monitoring Location Map

Location Code: -

- S1- PalsadaVillage**
- S2- Kthali Village**
- S3- Chote Bhandar Village**
- S4- Bade Bhandar Village**
- S5- Nursery**



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/S/01	Report No.:	VEL/ S/1802/001
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Village- Palsada	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	03-09/03/2018
Packing Status:	Temp Sealed	Receipt Date:	03/03/2018
Parameter Required:	As per Work Order	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.20	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.381	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	32.94	%
6.	Bulk density	USDA Method, 1968	1.33	gm/cc
7.	Chloride as Cl	USDA Method, 1968	84.3	mg/kg
8.	Calcium as Ca	USDA Method, 1968	428.1	mg/kg
9.	Sodium as Na	USDA Method, 1968	75.2	mg/kg
10.	Potassium as K	USDA Method, 1968	114.7	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.70	%
12.	Magnesium as Mg	USDA Method, 1968	79.6	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	241.6	kg./hect.
14.	Available Phosphorus	USDA Method, 1968	25.9	kg./hect.
15.	Zinc (as Zn)	USEPA 3050B	23.5	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	227.5	mg/kg
17.	Lead (as Pb)	USEPA 3050B	9.4	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.80	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	4.1	mg/kg
20.	Copper (as Cu)	USEPA 3050B	15.7	mg/kg

Shruti
(Tested By)

Munish
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/S/02	Report No.:	VEL/ S/1802/002
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Village- Kathli	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	03-09/03/2018
Packing Status:	Temp Sealed	Receipt Date:	03/03/2018
Parameter Required:	As per Work Order	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.31	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.331	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	38.1	%
6.	Bulk density	USDA Method, 1968	1.28	gm/cc
7.	Chloride as Cl	USDA Method, 1968	62.3	mg/kg
8.	Calcium as Ca	USDA Method, 1968	372.1	mg/kg
9.	Sodium as Na	USDA Method, 1968	72.4	mg/kg
10.	Potassium as K	USDA Method, 1968	125.6	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.76	%
12.	Magnesium as Mg	USDA Method, 1968	68.1	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	264.3	kg./hect.
14.	Available Phosphorus	USDA Method, 1968	26.9	kg./hect.
15.	Zinc (as Zn)	USEPA 3050B	14.2	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	217.3	mg/kg
17.	Lead (as Pb)	USEPA 3050B	7.8	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.74	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	5.0	mg/kg
20.	Copper (as Cu)	USEPA 3050B	15.8	mg/kg

Shishu
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/S/03	Report No.:	VEL/ S/1802/003
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Village-Chhote Bhandar	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	03-09/03/2018
Packing Status:	Temp Sealed	Receipt Date:	03/03/2018
Parameter Required:	As per Work Order	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.48	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.318	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	30.12	%
6.	Bulk density	USDA Method, 1968	1.34	gm/cc
7.	Chloride as Cl	USDA Method, 1968	64.12	mg/kg
8.	Calcium as Ca	USDA Method, 1968	380.3	mg/kg
9.	Sodium as Na	USDA Method, 1968	58.4	mg/kg
10.	Potassium as K	USDA Method, 1968	115.6	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.68	%
12.	Magnesium as Mg	USDA Method, 1968	69.52	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	298.5	kg./hect.
14.	Available Phosphorus	USDA Method, 1968	21.7	kg./hect.
15.	Zinc (as Zn)	USEPA 3050B	18.9	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	214.3	mg/kg
17.	Lead (as Pb)	USEPA 3050B	8.7	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.85	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	3.8	mg/kg
20.	Copper (as Cu)	USEPA 3050B	19.4	mg/kg

Shrishi
(Tested By)

Munika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/S/04	Report No.:	VEL/ S/1802/004
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Village-Bade Bhandar	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	03-09/03/2018
Packing Status:	Temp Sealed	Receipt Date:	03/03/2018
Parameter Required:	As per Work Order	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.69	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.351	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	34.8	%
6.	Bulk density	USDA Method, 1968	1.28	gm/cc
7.	Chloride as Cl	USDA Method, 1968	55.6	mg/kg
8.	Calcium as Ca	USDA Method, 1968	463.2	mg/kg
9.	Sodium as Na	USDA Method, 1968	58.4	mg/kg
10.	Potassium as K	USDA Method, 1968	153.9	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.92	%
12.	Magnesium as Mg	USDA Method, 1968	83.6	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	328.5	kg./hect.
14.	Available Phosphorus	USDA Method, 1968	27.4	kg./hect.
15.	Zinc (as Zn)	USEPA 3050B	18.5	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	182.6	mg/kg
17.	Lead (as Pb)	USEPA 3050B	11.2	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.75	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	3.1	mg/kg
20.	Copper (as Cu)	USEPA 3050B	22.6	mg/kg

Shishir
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/S/05	Report No.:	VEL/ S/1802/005
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	SOIL SAMPLE	Party Reference No.:	NIL
Sample Location:	Nursery	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	03-09/03/2018
Packing Status:	Temp Sealed	Receipt Date:	03/03/2018
Parameter Required:	As per Work Order	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS 2720, USEPA 3050B & USDA	Sampling Quantity:	2.0 Kg
		Sampling Type:	Composite

S. No.	Parameter	Test-Method	Result	Unit
1.	pH (at 25 °C)	IS : 2720 (P-26,RA2011)	7.63	--
2.	Conductivity	IS:14767-2000 Reaffirmed 2006	0.318	mS/cm
3.	Soil Texture	IS : 2720 (P-4, RA1995)	Silty Loam	--
4.	Color	USDA Method, 1968	Yellowish Red	--
5.	Water holding capacity	USDA Method, 1968	25.6	%
6.	Bulk density	USDA Method, 1968	1.40	gm/cc
7.	Chloride as Cl	USDA Method, 1968	63.8	mg/kg
8.	Calcium as Ca	USDA Method, 1968	274.1	mg/kg
9.	Sodium as Na	USDA Method, 1968	76.4	mg/kg
10.	Potassium as K	USDA Method, 1968	132.5	kg/hect.
11.	Organic Matter	IS:2720 (P-22, RA2009)	0.59	%
12.	Magnesium as Mg	USDA Method, 1968	63.58	mg/kg
13.	Available Nitrogen as N	IS:14684, RA2006	251.2	kg./hect.
14.	Available Phosphorus	USDA Method, 1968	22.3	kg./hect.
15.	Zinc (as Zn)	USEPA 3050B	15.4	mg/kg
16.	Manganese (as Mn)	USEPA 3050B	175.4	mg/kg
17.	Lead (as Pb)	USEPA 3050B	8.0	mg/kg
18.	Cadmium (as Cd)	USEPA 3050B	0.62	mg/kg
19.	Chromium (as Cr)	USEPA 3050B	3.1	mg/kg
20.	Copper (as Cu)	USEPA 3050B	15.9	mg/kg

Shishir
(Tested By)

Munika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Third Quarter Environmental Monitoring

4.6 Effluent Sample Analysis Report

Locations

1. STP Outlet
2. ETP Outlet



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/WW/02	Report No.:	VEL/WW/1712/01
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	WASTE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	ETP Outlet	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	25/12/2017 to 27/12/2017
Preservation:	Refrigerated	Receipt Date:	23/12/2017
Parameter Required:	As per work order	Sampling Date:	22/12/2017
Analysis Protocol:	APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr

S. No.	Parameter	Test-Method	Result	Unit	*Standards		
					In-Land Surface Water	Public Sewers	Land for Irrigation
6.	pH (at 25 °C)	APHA 22nd Edition 2012, 4500-H+ B	7.68	mg/l	5.5 to 9.0	5.5 to 9.0	5.5 to 9.0
7.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	23.5	mg/l	30	350	100
8.	COD	APHA 22nd Edition 2012, 5220 B	89.4	mg/l	250	--	--
9.	Total Suspended Solids	APHA 22nd Edition 2012, 2540 D	29.2	mg/l	100	600	200
10.	Oil and Grease	APHA 22nd Edition 2012,5520 B	2.4	mg/l	10	20	10


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Page 2 of 2



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/WW/01	Report No.:	VEL/WW/1712/01
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	WASTE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	STP Outlet	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	25/12/2017 to 27/12/2017
Preservation:	Refrigerated	Receipt Date:	23/12/2017
Parameter Required:	As per work order	Sampling Date:	22/12/2017
Analysis Protocol:	APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr

S. No.	Parameter	Test-Method	Result	Unit	*Standards		
					In-Land Surface Water	Public Sewers	Land for Irrigation
1.	pH (at 25 °C)	APHA 22nd Edition 2012, 4500-H+ B	8.02	mg/l	5.5 to 9.0	5.5 to 9.0	5.5 to 9.0
2.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	22.5	mg/l	30	350	100
3.	COD	APHA 22nd Edition 2012, 5220 B	98.7	mg/l	250	--	--
4.	Total Suspended Solids	APHA 22nd Edition 2012, 2540 D	18.5	mg/l	100	600	200
5.	Oil and Grease	APHA 22nd Edition 2012,5520 B	0.6	mg/l	10	20	10


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Page 1 of 2

Fourth Quarter Environmental Monitoring

4.6 Effluent Sample Analysis Report

Locations

1. STP Outlet
2. ETP Outlet



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/WW/01	Report No.:	VEL/WW/1802/01
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	WASTE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	STP Outlet	Reporting Date:	07/03/2018
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	01-06/03/2018
Preservation:	Refrigerated	Receipt Date:	01/03/2018
Parameter Required:	As per work order	Sampling Date:	27/02/2018
Analysis Protocol:	APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr

S. No.	Parameter	Test-Method	Result	Unit	*Standards		
					In-Land Surface Water	Public Sewers	Land for Irrigation
1.	pH (at 25 °C)	APHA 22nd Edition 2012, 4500-H+ B	7.94	mg/l	5.5 to 9.0	5.5 to 9.0	5.5 to 9.0
2.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	24.1	mg/l	30	350	100
3.	COD	APHA 22nd Edition 2012, 5220 B	94.3	mg/l	250	--	--
4.	Total Suspended Solids	APHA 22nd Edition 2012, 2540 D	15.8	mg/l	100	600	200
5.	Oil and Grease	APHA 22nd Edition 2012,5520 B	0.5	mg/l	10	20	10


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/WW/02	Report No.:	VEL/WW/1802/01
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	WASTE WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	ETP Outlet	Reporting Date:	07/03/2018
Sample Collected by:	Vardan EnviroLab Team	Period of Analysis:	01-06/03/2018
Preservation:	Refrigerated	Receipt Date:	01/03/2018
Parameter Required:	As per work order	Sampling Date:	27/02/2018
Analysis Protocol:	APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr

S. No.	Parameter	Test-Method	Result	Unit	*Standards		
					In-Land Surface Water	Public Sewers	Land for Irrigation
6.	pH (at 25 °C)	APHA 22nd Edition 2012, 4500-H+ B	7.55	mg/l	5.5 to 9.0	5.5 to 9.0	5.5 to 9.0
7.	BOD (3 Days at 27 °C)	IS 3025,P-44,1999 (Reaffirmed 2003)	26.1	mg/l	30	350	100
8.	COD	APHA 22nd Edition 2012, 5220 B	85.2	mg/l	250	--	--
9.	Total Suspended Solids	APHA 22nd Edition 2012, 2540 D	27.3	mg/l	100	600	200
10.	Oil and Grease	APHA 22nd Edition 2012,5520 B	2.0	mg/l	10	20	10

Shivshankar
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

**Third Quarter Environmental Monitoring
4.7 Drinking Water Quality Analysis**



Figure No.9. Plan Showing Drinking water sampling Location

Location Name- Site Office



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
 (ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/01	Report No.:	VEL/DW/1712/001
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	DRINKING WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Site Office	Reporting Date:	28/12/2017
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	25/12/2017 to 27/12/2017
Preservation:	Refrigerated	Receipt Date:	25/12/2017
Parameter Required:	As per IS 10500-2012	Sampling Date:	22/12/2017
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS:10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.52	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	49.5	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	15.80	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	44.2	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	16.40	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl ⁻ B	BDL(DL 0.2mg/l)	mg/l	0.2	1
11.	#Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	2.45	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	72.0	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	2.67	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.12	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	0.19	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.09	mg/l	0.3	No relaxation
18.	#Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Shrishti
(Tested By)

Manila
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/01		Report No:		VEL/DW/1712/001	
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012		
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source	
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002	
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0	
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15	
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5	
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.1	0.3	
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation	
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation	
28.	⁶³ Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation	
29.	⁷⁵ Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05	
30.	²⁰¹ Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation	
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		

Note: - *BDL-Below Detection Limit, **DL- Detection Limit

Shruti
(Tested By)

Manika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

**Fourth Quarter Environmental Monitoring
4.7 Drinking Water Quality Analysis**



Figure No.9. Plan Showing Drinking water sampling Location

Location Name- Site Office



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
 Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
 Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number:	VEL/KWPCL/W/01	Report No.:	VEL/DW/1802/001
Name & Address of the Party:	M/s Korba West Power Company Limited Village Chhote Bhandar, Post office Bade Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 (Chhattisgarh)	Format No.:	5.10 F-01
Sample Description:	DRINKING WATER SAMPLE	Party Reference No.:	NIL
Sample Location:	Site Office	Reporting Date:	10/03/2018
Sample Collected by:	Vardan EnviroLab Representative	Period of Analysis:	03-09/03/2018
Preservation:	Refrigerated	Receipt Date:	03/03/2018
Parameter Required:	As per IS 10500-2012	Sampling Date:	27/02/2018
Sampling and Analysis Protocol:	IS-10500-2012, APHA 22nd Edition 2012	Sampling Quantity:	2.0 Ltr
		Sampling Type:	Grab

S. No.	Parameter	Test-Method	Result	Unit	Limits of IS:10500 -2012	
					Requirement (Acceptable Limit)	Permissible limit in the Absence of Alternate Source
1.	pH (at 25 °C)	APHA (22 nd Edition)2012, 4500-H ⁺ B	7.59	--	6.5 to 8.5	No Relaxation
2.	Colour	APHA (22 nd Edition)2012, 2120 B	*BDL (**DL 5Hazen)	Hazen	5	15
3.	Turbidity	APHA (22 nd Edition)2012, 2130 B	*BDL (**DL 0.1 NTU)	NTU	1	5
4.	Odour	APHA (22 nd Edition)2012, 2150 B	Agreeable	--	Agreeable	Agreeable
5.	Taste	APHA (22 nd Edition)2012, 2160 B	Agreeable	--	Agreeable	Agreeable
6.	Total Hardness as CaCO ₃	APHA (22 nd Edition)2012, 2340 C	47.3	mg/l	200	600
7.	Calcium as Ca	APHA (22 nd Edition)2012, 3500 Ca B	16.2	mg/l	75	200
8.	Alkalinity as CaCO ₃	APHA (22 nd Edition)2012, 2320 B	46.7	mg/l	200	600
9.	Chloride as Cl	APHA (22 nd Edition)2012, 4500-Cl ⁻ B	18.4	mg/l	250	1000
10.	Residual free Chlorine	APHA 22 nd Edition, 4500 Cl ⁻ B	BDL(DL 0.2mg/l)	mg/l	0.2	1
11.	Cyanide as CN	APHA (22 nd Edition)2012, 4500 CN ⁻ D	*BDL(**DL 0.02 mg/l)	mg/l	0.05	No Relaxation
12.	Magnesium as Mg	APHA (22 nd Edition)2012, 3500 Mg B	1.67	mg/l	30	100
13.	Total Dissolved Solids	APHA (22 nd Edition)2012, 2540 C	74	mg/l	500	2000
14.	Sulphate as SO ₄	APHA (22 nd Edition)2012, 4500 E	2.51	mg/l	200	400
15.	Fluoride as F	APHA (22 nd Edition)2012, 4500-F ⁻ D	0.10	mg/l	1.0	1.5
16.	Nitrate as NO ₃	IS 3025 (P-34) 2003	0.15	mg/l	45	No Relaxation
17.	Iron as Fe	APHA (22 nd Edition)2012, 3500-Fe B	0.08	mg/l	0.3	No relaxation
18.	#Aluminium as Al	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.03	0.2
19.	Boron	APHA (22 nd Edition)2012, 4500B C	*BDL(**DL 0.1 mg/l)	mg/l	0.5	1
20.	Total Chromium as Cr	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	No Relaxation

Shreshth
(Tested By)

Navika
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
 b) Total liabilities of our lab will be restricted to the invoice amount only
 c) The sample will be destroyed after retention time unless otherwise specified
 d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample No.:		VEL/KWPCL/W/01		Report No:		VEL/DW/1802/001	
S. No	Parameter	Test-Method	Result	Unit	Limits of IS:10500-2012		
					Requirement (Acceptable) Limit	Permissible limit in the Absence of Alternate Source	
21.	Phenolic Compounds	APHA (22 nd Edition)2012, 5530 C	*BDL(**DL 0.001 mg/l)	mg/l	0.001	0.002	
22.	Anionic Detergents as MBAS	APHA (22 nd Edition)2012, 5540 C	*BDL(**DL 0.02 mg/l)	mg/l	0.2	1.0	
23.	Zinc as Zn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	5	15	
24.	Copper as Cu	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.03 mg/l)	mg/l	0.05	1.5	
25.	Manganese as Mn	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.1	0.3	
26.	Cadmium as Cd	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.06 mg/l)	mg/l	0.003	No Relaxation	
27.	Lead as Pb	APHA (22 nd Edition)2012, 3111 B	*BDL(**DL 0.13mg/l)	mg/l	0.01	No Relaxation	
28.	⁶³ Selenium as Se	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	No Relaxation	
29.	⁷⁵ Arsenic as As	APHA (22 nd Edition)2012, 3114 B	*BDL(**DL 0.01 mg/l)	mg/l	0.01	0.05	
30.	²⁰¹ Mercury as Hg	APHA (22 nd Edition)2012, 3112 B	*BDL (**DL 0.001 mg/l)	mg/l	0.001	No Relaxation	
31.	Total Coliform	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		
32.	E. Coli	IS 1622,1981(Reaffirmed 2003)	Absent	MPN/100ml	Shall not be detectable in any 100 ml sample		

Note: - *BDL-Below Detection Limit, **DL- Detection Limit


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Page 2 of 2

Third Quarter Environmental Monitoring 4.8 Ground water level Monitoring



Figure No.10 Plan Showing Ground Water level Monitoring Location Map

Location Code: -

- GW1- Site Office**
- GW2- PalsadaVillage**
- GW3- Kthali Village**
- GW4- Chote Bhandar Village**
- GW5- Bade Bhandar Village**



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036
Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)
Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404
(ISO 9001 | ISO 14001 | OHSAS 18001 | MoEF & CC Recognized | NABL Accredited | HSPCB & RSPCB Approved)

Test Certificate

Sample Number: VEL/KWPCL/W/01 Report No.: VEL/W/1712/001
Name & Address of Party: M/s Korba West Power Company Limited Format No.: 5.10 F-01
Village ChhoteBhandar, Post office Bade Party Reference No.: NIL
Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 Reporting Date: 26/12/2017
(Chhattisgarh)
Monitoring Date: 22/12/2017
Sample Description: Ground Water Level Monitoring
Sample Collected by: Vardan EnviroLab Representative

RESULTS

S. No.	Location	Latitude & Longitude	Result (In meter)
1.	Site Office	21°44'07.3"N&83°15'01.4" E	6.2
2.	Village Palsada	21°44'07.3"N&83°15'01.4" E	5.8
3.	Village Kathli	21°43'27.5"N&83°16'25.2" E	6.5
4.	Village ChhoteBhandar	21°43'48.5"N&83°16'49.3" E	6.1
5.	Village Bade Bhandar	21°44'17.4"N&83°16'49.3" E	6.6


(Tested By)


(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Fourth Quarter Environmental Monitoring

4.8 Ground water level Monitoring



Figure No.10 Plan Showing Ground Water level Monitoring Location Map

Location Code: -

- GW1- Site Office
- GW2- Palsada Village
- GW3- Kthali Village
- GW4- Chote Bhandar Village
- GW5- Bade Bhandar Village



Vardan EnviroLab

Regd. Off: D-142, Sushant Lok-III, Sector-57, Gurgaon - 122003 (Haryana) Tel: 0124-4291036

Laboratory: Samaspur, Opposite Amity International School, Sector-51, Gurgaon - 122001 (Haryana)

Branch Off: Plot No. 24 & 25, Narayan Vihar, B-Block, Jaipur - 302035 (Rajasthan) Tel: 0141-2983404

(ISO 9001|ISO 14001|OHSAS 18001|MoEF & CC Recognized|NABL Accredited|HSPCB & RSPCB Approved)

Test Certificate

Sample Number: **VEL/KWPCL/W/01** Report No.: **VEL/W/1802/001**
Name & Address of Party: **M/s Korba West Power Company Limited** Format No.: **5.10 F-01**
Village ChhoteBhandar, Post office Bade Party Reference No.: **NIL**
Bhandar, Tehsil Pussore, Dist.-Raigarh -496100 Reporting Date: **10/03/2018**
(Chhattisgarh)
Monitoring Date: **28/02/2018**
Sample Description: **Ground Water Level Monitoring**
Sample Collected by: **Vardan EnviroLab Representative**

RESULTS

S. No.	Location	Latitude & Longitude	Depth (In meter)
1.	Site Office	21°44'07.3"N&83°15'01.4" E	7.1
2.	Village Palsada	21°44'07.3"N&83°15'01.4" E	6.3
3.	Village Kathli	21°43'27.5"N&83°16'25.2" E	6.9
4.	Village ChhoteBhandar	21°43'48.5"N&83°16'49.3" E	7.9
5.	Village Bade Bhandar	21°44'17.4"N&83°16'49.3" E	7.5

Shreshthi
(Checked By)



NOTE: a) The results listed refer only to the tested samples & applicable parameters
b) Total liabilities of our lab will be restricted to the invoice amount only
c) The sample will be destroyed after retention time unless otherwise specified
d) This report is not to be reproduced wholly or in part and cannot be used as evidence in the court of law

Chapter – 5.0 CONCLUSION

KWPCL authorities have been taken successful steps in controlling environmental pollution in and around the project. This fact is clear from analytical results of different environmental parameters. A brief conclusion is as follows.

Sr. No.	Environmental Parameters	Conclusion
5.1	Air Environment	After analysis of the samples from five different locations it is observed that both the individuals and average concentrations of air pollutants in respect of SO ₂ , NO ₂ , PM ₁₀ , PM _{2.5} , CO and Mercury are well within the prescribed limits of NAAQM standards. People of township and of surrounding villages do not have any problems regarding the air quality and have no grievances because of Thermal Power Plant activities.
5.2	Water Environment	The analytical result of the samples from the ground water of villages, surface water from river, and domestic & industrial effluent after treatment shows that the concentrations of different water parameters are well within prescribed limits and will not cause any adverse impact on human health and on surrounding area. People of surrounding areas express satisfaction about the water quality of that area.
5.3	Noise Environment	The observations taken at Five village location during day and night time shows that the noise level are well within prescribed limits of CPCB. Hence there is no possibility of any adverse effect of noise generated due to Thermal Power Plant activities on peoples of Surrounding areas.

All the above details show that Thermal Power Plant of KWPCL is not causing any adverse impact on the human health and ecological balance.

ANNEXURE-II

Plantation on 33% land of 487 acres	163 acres
Density of plantation	2500 plants/Hectare
Area required per plant	4.0 SQM
Total No. of plantation completed	1,95,998 No's
2011-12	30,000
2012-13	20,571
2013-14	37,139
2014-15	43,107
2015-16	40,278
2016-17	17,517
2017- 18	7,386
Survival rate maintained	>70%

ANNEXURE-III



KORBA WEST POWER COMPANY LIMITED VILL-CHOTE BHANDAR, TEHSIL-PUSSORE, DISTRICT- RAIGARH (C.G.)

FLY ASH UTILIZATION REPORT Month-Mar' 2018

Month	Name of the Company	Fly ash generation in the month (MT)	Fly ash utilization for the month of Mar' 2018									Cumulative fly ash generation from April'17 (MT)	Cumulative fly ash utilization from April'17 (MT)	Cumulative fly ash utilization from April'17 (%)	Required utilization as per notification for the year (as per action plan schedule)	Total utilization in the previous year MT/Year	Details of Transporter	Details of Firm/ Agency/ Cement Plant/ Brick Plant taking Fly Ash
			Supply to Cement Plant (MT)	Brick making plant (MT)	Land filling (MT)	Ash dyke raising/co nstruction (MT)	Agricultur e (MT)	Mine filling (MT)	Road Making/ot her (MT)	Total utilization in (MT)	% age utilization in (MT)							
Apr-17	Korba West Power Company Limited	113955.0	Nil	0	40853	42400	Nil	Nil	Nil	83253	73.06%	113955.0	83253	73.06%	113955.0	308006	NA	Maa Durga & Other Transports & Inhouse
May-17	Korba West Power Company Limited	59147.0	Nil	0	22890	51054	Nil	Nil	Nil	73944	125.02%	173102.0	157197	90.81%	59147.0	308006	NA	Maa Durga & Other Transports & Inhouse
Jun-17	Korba West Power Company Limited	0.0	Nil	0	0	95816	Nil	Nil	Nil	95816	NA	173102.0	253013	146.16%	0.0	308006	NA	Inhouse
Jul-17	Korba West Power Company Limited	0.0	Nil	0	0	0	Nil	Nil	Nil	0	NA	173102.0	253013	146.16%	0.0	308006	NA	
Aug-17	Korba West Power Company Limited	0.0	Nil	0	0	0	Nil	Nil	Nil	0	NA	173102.0	253013	146.16%	0.0	308006	NA	
Sep-17	Korba West Power Company Limited	0.0	Nil	0	0	0	Nil	Nil	Nil	0	NA	173102.0	253013	146.16%	0.0	308006	NA	
Oct-17	Korba West Power Company Limited	0.0	Nil	0	0	0	Nil	Nil	Nil	0	NA	173102.0	253013	146.16%	0.0	308006	NA	
Nov-17	Korba West Power Company Limited	0.0	Nil	0	0	0	Nil	Nil	Nil	0	NA	173102.0	253013	146.16%	0.0	308006	NA	
Dec-17	Korba West Power Company Limited	0.0	Nil	0	0	0	Nil	Nil	Nil	0	NA	173102.0	253013	146.16%	0.0	308006	NA	
Jan-18	Korba West Power Company Limited	0.0	Nil	0	0	0	Nil	Nil	Nil	0	NA	173102.0	253013	146.16%	0.0	308006	NA	
Feb-18	Korba West Power Company Limited	0.0	Nil	0	0	0	Nil	Nil	Nil	0	NA	173102.0	253013	146.16%	0.0	308006	NA	
Mar-18	Korba West Power Company Limited	0.0	Nil	0	0	0	Nil	Nil	Nil	0	NA	173102.0	253013	146.16%	0.0	308006	NA	

*1) Plant was not in operation throughout the month.